



**SHRI BAJRANG
POWER AND ISPAT LTD.**

BELIEF, STRONGER THAN STEEL.

POWER | STEEL | MINING

SBPIL/BORJHARA/ENV/25-26/0692

Date: 27.06.2025

To,
Regional Officer,
Integrated Regional Office,
Ministry of Environment, Forests and Climate Change
Ground Floor, Aranya Bhawan, North Block, Sector- 19,
Naya Raipur, Atal Nagar, Chhattisgarh - 492002.

Sub: Submission of Six-Monthly Compliance Report for the period Oct'24 to Mar'25.

Ref: 1. Environmental Clearance No. F. No. J-11011/531/2007-IA II (I) dated 17.01.2008 From Govt. Of India, Ministry of Environment Forest& Climate Change, New Delhi for Ferro Alloys Plant (14,400 TPA) with Bio - Mass based (Rice Husk) Power Plant (08 MW) at Shri Bajrang Power & Ispat Ltd. Vill. - Borjhara, UrlaGuma Road, Raipur (C.G.)

Dear Sir,

With reference to above cited subject, please find enclosed herewith Six Monthly Compliance Report for the period Oct'24 to Mar'25 along with all the supporting documents as required by your good office in compliance of Environmental Clearance granted by Ministry of Environment Forest& Climate Change (MoEF&CC), New Delhi, vide their letter F.No. J-11011/531/2007 -IA II (I) dated 17.01.2008 for Ferro Alloys Plant (14,400 TPA) with Bio - Mass based (Rice Husk) Power Plant (08 MW) at M/s Shri Bajrang Power & Ispat Ltd situated at Village- Borjhara, Urla - Guma Road, Raipur 493221 (C.G.).

Hope, you will find the above in order.

Thanking you,

For **SHRI BAJRANG POWER & ISPAT LTD. (Borjhara Division)**


Authorized Signatory

Encl: As Mentioned Above

**CC- 1. Regional Officer, Chhattisgarh Environment Conservation, New Office Building
Ring Road No. 2 Tatibandh, Raipur (CG)**
**2. Member Secretary, Chhattisgarh Environment Conservation Board, North Block,
Sector -19, Atal Nagar Raipur Chhattisgarh.**

CIN No. : U27106CT2002PLC015184

Regd. Office / Works : Vill. Borjhara, Urla-Guma Road, Urla Growth Center, Raipur 492003 (C.G.)

Ph. : +91-771-4288019 / 29 / 39, Fax : +91-771-4288123

E-mail : info.bjr@goelgroup.co.in, commercial.bjr@goelgroup.co.in



**COMPLIANCE REPORT OF SPECIFIC & GENERAL CONDITIONS OF THE ENVIRONMENT CLEARANCE GRANTED BY MINISTRY OF ENVIRONMENT AND FORESTS. NEW DELHI FOR FERRO ALLOY PLANT (14,400 TPA) WITH BIO - MASS BASED (RICE HUSK) POWER PLANT (08 MW) BY M/S. SHRI BAJRANG POWER AND ISPAT LIMITED AT VILLAGE: BOJHARA, DISTRICT: RAIPUR (CG).
REF: F.NO.J-11011/531/2007-IA II (I) DATED 17.01.2008**

A. SPECIFIC CONDITIONS STATUS AS ON 31/03/2025

Sr. No.	Compliance Conditions	Status 31.03.2025
i.	Electro Static Precipitator (ESP) along with plus jet bag filters shall be installed in the hoper instead of cyclone and wet scrubbers to control emissions with 50 mg/Nm3.	One no. ESP is installed in AFBC based Biomass power plant and Two no. Pulse Jet Bag Filters are installed in Ferro alloys units to control and maintain the emission level within 50 mg/Nm3.
ii.	In-plant control measures for checking fugitive emissions from all the vulnerable sources shall be provide. Fume and dust extraction system with bag filter shall be provided at the material transfer and discharge points to control fugitive emissions. Further, specific measures like water sprinkling around the coal stock piles asphaltting or concreting of the roads shall be done to control to reduce the dust generation and fugitive emission during handling.	Fugitive emission is being controlled by regular operation of Mist water spray system, installed at closed conveyor belts circuits and other areas. Permanent & movable water sprinklers are also installed at required locations. Covered conveyor belt circuits of material transfer & discharge points, connected with dust extraction system & Bag filters. All internal roads are RCC/Concrete blocks and same are being cleaned by Mechanical sweeping machine and water sprinkling is also being done on these roads, raw material yard and other area on regular basis by water tanker to control dust generation during process and vehicle movements. We have also constructed wheel wash system at near main gate in order to control fugitive emission due to vehicle movements. photographs enclosed as Annexure - I.
iii.	Secondary fugitive emission from all the sources including existing Sponge Iron plant and captive power plant shall be controlled within the latest permissible limits, issued by the Ministry and regularly monitored. Guidelines/code of practice issued by the CPCB shall be followed.	Secondary fugitive emission from all the sources including existing Sponge Iron plant and Captive power plant is being controlled and maintained well within the latest prescribed norms, by installation and effective operation of installed Air Pollution control equipment's. Guidelines/code of practice, issued by the CPCB are being followed.
iv.	Total water requirement from River Kharun/Shivnath shall not exceed 2940 M3/day. No water shall be sourced from the ground water sources. All the acidic and alkaline effluent shall be neutralized in neutralization tank and treated effluent shall be recycled/reused in the process and Green belt development. Cooling Tower blow down shall be used for dust suppression in fuel handling area. Domestic waste water shall be treated in septic tank followed by soak pit. No waste water shall be discharged outside the factory premises and Zero discharge shall be adopted.	Agreed and being followed. No ground water is being used for process. We have obtained NOC from Central Ground water, Jamnagar House, man singh Road, new delhi vide letter no. CGWA/NOC/IND/REN/2024/9081 dated 12/02/2024 valid up to 04/01/2027 for withdrawal of 75 KLD ground water only for Drinking & Domestic purpose. Surface water from Kharun River is being used for industrial purpose after obtaining permission from authorized agency. Industrial discharged water & Cooling Tower blow down is being used for dust suppression in fuel handling area, Fly Ash loading/unloading

		area and on our internal roads. Domestic discharge water is being treated in septic tank followed by soak pit. Generated waste water is not being discharged outside the factory premises; hence Zero discharge is being maintained all the time.
v.	Prior permission for the drawl of 2940 M3/day water from Kharun River from the concerned department shall be obtained.	We have obtained permission for the drawl of 2940 M3/day water from Kharun River by water resource department, Mantralaya Raipur (C.G.) vide their letter 5010/302/WR/TECH/03/IWS/D-4 dated 26.10.2004.
vi.	All the granulated slag shall be providing to cement/Brick manufacturers for manufacturing Pozzolona slag cement (PSC) or making Bricks. No Granulated slag shall be used for road constructions and filling low lying areas. All the char, Dolochar shall be used in AFBC Boiler. Hexavalent Chromium present in the slag shall be converted in to trivalent Chromium. Ferro chrome shall be stored in secured landfill as per the CPCB guidelines. Bottom ash shall be disposed off suitably designed land fill as per CPCB guidelines to prevent leaching of sub soil and underground aquifer. ETP sludge after drying shall be used as a fertilizer for green belt development. Used oil shall be sold to recyclers and pre-processors.	Generated slag from Ferro Alloys unit after crushing, screening and material removing is being used in our Fly Ash Bricks plant. Bottom ash from 08 MW Biomass Power Plant is also being used in our Fly Ash Bricks plant as a raw material. Generated Used oil is being used for lubrication in Roller conveyor as well as Belt conveyors of the plant and balance if any, is being sold to recyclers /authorized agencies. All generated char/Dolochar from our SID unit is being used in our AFBC boiler of Borjhara and Gondwara unit.
vii.	All the Fly ash shall be utilized as per Fly Ash Notification, 1999 subsequently amended in 2003.	Agreed and is being utilized as per Fly Ash notification.
viii.	Out of total 21 Hectare green belt shall be developed in 7.0 Hectare (33%) within and around the plant premises as per the CPCB guidelines in consultation with DFO.	Agreed and is being developed & maintained as per the CPCB guidelines and Plant species in consultation with DFO has been planted. Plantation Pictures attached as Annexure - II
ix.	All the recommendations made in the charter on Corporate Responsibility for Environment Protection (CREP) for the Ferro Alloy plants should be implemented.	Agreed and being implemented.



B. GENERAL CONDITIONS STATUS AS ON 31/03/2025.



Sr. No.	Conditions Laid Down by MoEF&CC	Compliance by SBPIL
i.	The project authorities must strictly adhere to the stipulations made by the Chhattisgarh Environment Conservation Board (CECB) and the State Government.	Agreed and being complied.
ii.	No further expansion or modifications in the plant shall be carried out without prior approval of the Ministry of Environment and Forest.	Noted and Agreed. For future expansion or modification in the plant, prior approval will be taken from MoEF&CC.
iii.	The gaseous emissions from various process units shall conform to the load / mass-based standards notified by this Ministry on 19 th May, 1993 and standards prescribed from time to time. The CECB may specify more stringent standards for the relevant parameters keeping in view the nature of the industry and its size and location. At no time, the emission level shall go beyond the prescribed standards. Interlocking facilities shall be provided so that process can be automatically stopped in case emission level exceeds the limit.	Noted and Agreed. Inter locking system has been provided which can trip raw material feed to process equipment, in case of non-working of pollution control equipment. The gaseous emission for Various stacks being maintained as per prescribed norms and monitoring reports are being submitted time to time to concerned authorities.
iv.	Continuous stack monitoring facilities for all the major stacks and adequate air pollution control systems shall be provided to keep emission levels below with permissible limits and reports submitted to the Ministry's Regional office at Bhopal and CECB/CPCB once in six months.	Online stack emission monitoring system for continuous monitoring of PM, Sox, NOx has been installed on existing major (RCC) stack, connected with Suitable & effective ESP. Bag Filters are also installed at different locations for maintaining the emission level well within the permissible limits. Reports are being timely submitted to concerned authorities. Online Monitoring Reports enclosed as Annex. - III
v.	At least four ambient Air quality-monitoring station should be established in the downward direction as well as where maximum ground level concentration of SPM, SO ₂ and NO _x are anticipated in consultation with the CECB. Data on ambient air quality and stack emission should be regularly submitted to this ministry including its Regional office at Bhopal and the CECB/CPCB once in six months.	Since Ferro Alloys unit and Bio Mass based Power Plant are situated in same campus with other plants, hence installed Ambient Air quality monitoring stations are common for all plants. Both Ambient Air quality and stack emission monitoring are being carried out by us and outside authorized agencies and reports are being submitted timely. Copy of Monitoring Report is enclosed as Annex. - IV
vi.	Industrial waste water shall be properly collected, treated so as to conform to the standards prescribed under GSR 422(E) dated 19 May'1993 and 31 December 1993, or as amended from time to time. The treated waste water shall be utilized for plantation purpose.	Agreed and Being Complied. Plant Discharge water after treatment by settling tank is being used for dust suppression and Plantation purpose.
vii.	The overall noise levels in and around the plant area shall be kept well within the standards (85 dBA) by providing noise control measures including acoustic hoods, silencers, enclosures etc. on all sources noise generation. The ambient noise levels should conform to the standards prescribed under EPA Rules, 1989 viz. 75 dBA (day time) and 70 dBA (night time).	Agreed and being followed. However personal protective equipment like ear plugs are being provided to concerned employees of Noise prone area. The ambient noise level is maintained well within the latest prescribed norms. Copies of Noise level reports are enclosed as Annexure - V
viii.	Occupational health surveillance of the worker shall be done on regular basis and record maintained as per the factories Act.	Agreed. Annual Medical checkup of all the employees are being carried out and records are being maintained. Company has constructed a own "Occupational health Centre with well qualified & experience medical staff within plant premises". Copies of Medical checkup report of employee for

		sample are enclosed as Annex. -VI.
ix.	The company shall develop surface water harvesting structures to harvest the rain water for utilization in lean season besides the recharging the ground water table.	Agreed and being maintained. There are 5 nos. Rain Water Harvesting Pits have been constructed inside the plant premises at different location. In which 5 nos. injection wells for recharging of both surface runoff and roof top water. Photographs enclosed as Annexure - VII
x.	The project proponent shall also comply with all the environmental protection measures and safeguards recommended in the EIA/EMP report. Further the company must undertake socio-economic development activities in the surrounding villages like community development program, educational program, drinking water supply and health care etc.	All the environmental protection measures and safeguards recommended in the EIA/EMP report and socio-economic development activities like community development programs, educational programs, drinking water supply and health care etc. are being conducted in the surrounding villages under CSR program by us.
xi.	The project authorities shall provide Rs.5.00 Crores and Rs. 30.00 Lakhs earmarked towards the capital cost and recurring cost/annum for environment pollution control measures and used judiciously to implement the conditions stipulated by the ministry of environment and forests as well as the state govt. An implementation schedule for implementing all the conditions stipulated herein shall be submitted to the Ministry including its Regional Office at Bhopal. The funds so provided should not be diverted for any other purpose.	Agreed and being followed.
xii.	The regional office of this Ministry at Bhopal/CPCB/CECB will monitor the stipulated conditions. A six monthly compliance report and the monitored data along with statistical interpretation shall be submitted to them regularly.	Six monthly compliance report and monitoring data are being submitted to concerned authorities timely.
xiii.	The project proponent shall inform the public that the project has been accorded environment clearance letter are available with the CECB and may also be seen at the website of the Ministry of Environment and Forests http://envfor.nic.in . This should be advertised within seven days from the date of issue of the clearance letter at least in two local newspapers that are widely circulated in the region of which one shall be in the vernacular language of the locality concerned and a copy of the same shall be forwarded to the Regional office at Bhopal.	Agreed and being followed. Copy of the Clearance letter already sent to concerned.
xiv.	The project authorities shall inform the Regional Office as well as Ministry, the date of Financial closures and final approval of the project by the concerned authorities and the date of commencing the land development work.	Agreed and already sent to concerned authorities.



Shri Bajrang Power & Ispat Limited (Borjhara Division)

Water Tanker

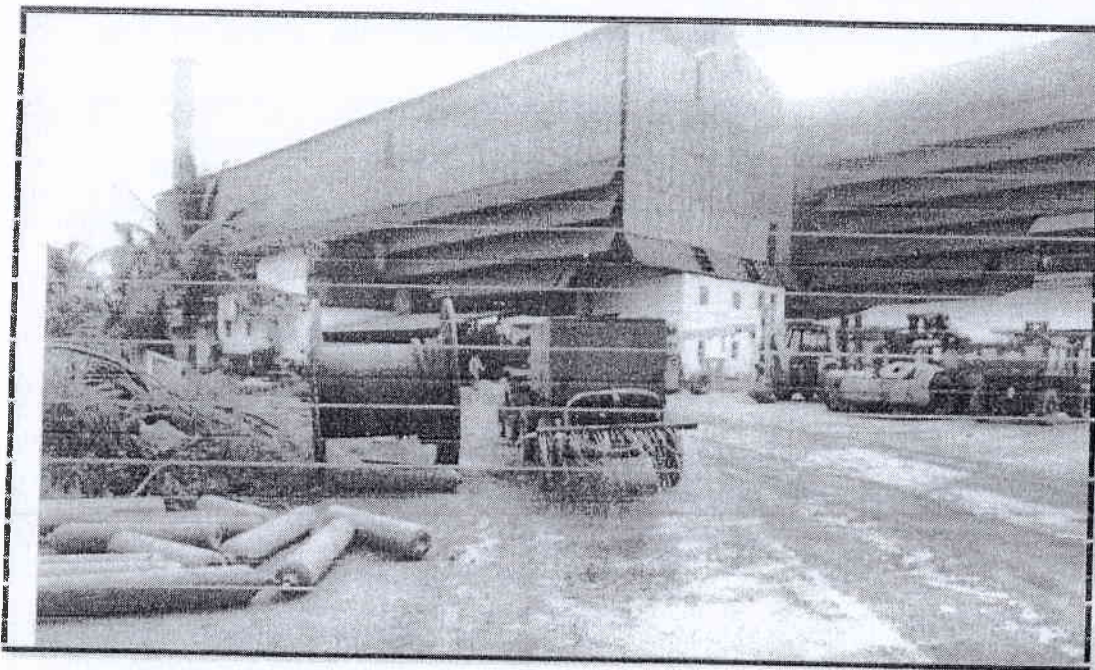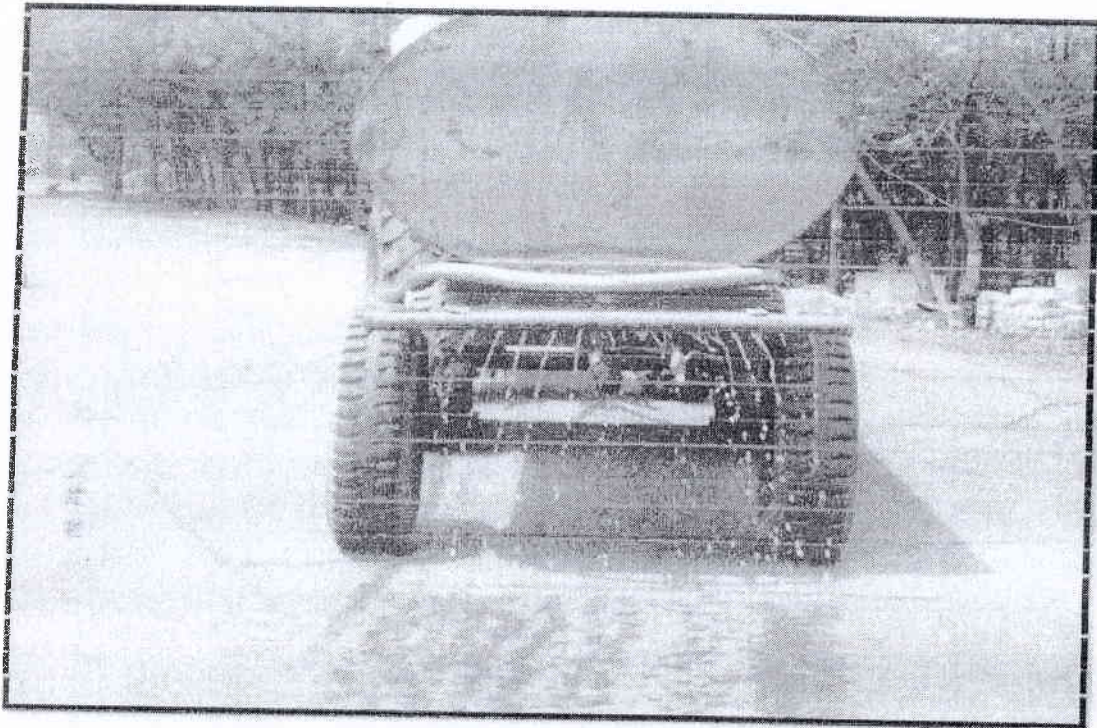


Handwritten signature

Mechanical Sweeping Machine



Relof


Wheel Wash System

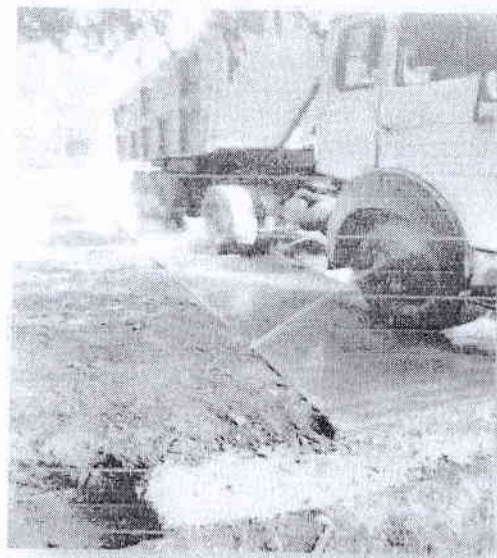


Handwritten signature or initials.

Shri Bajrang Power & Ispat Limited
Inside Plantation

Near Admin Building

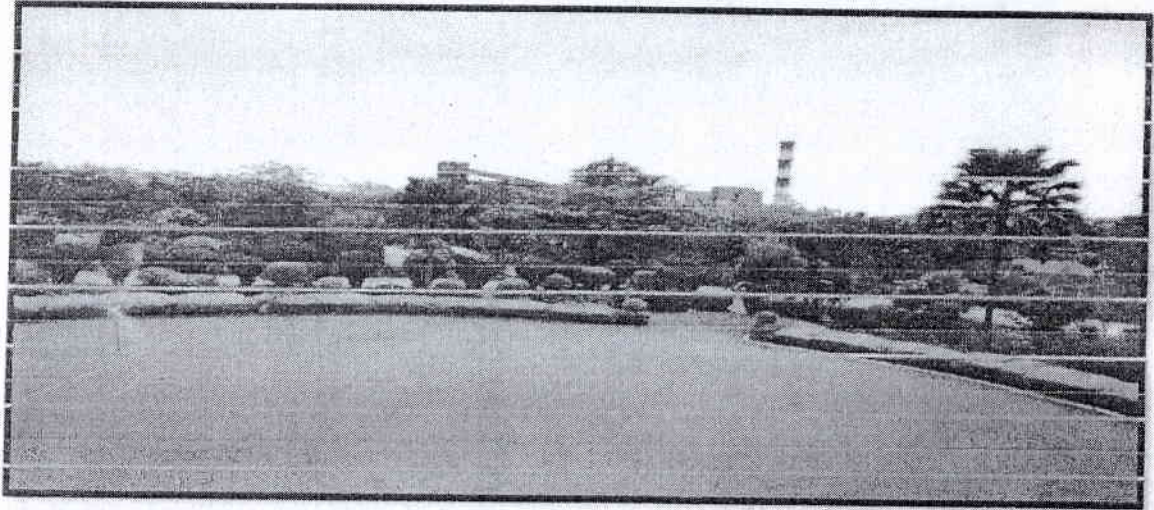


Near Boundary wall

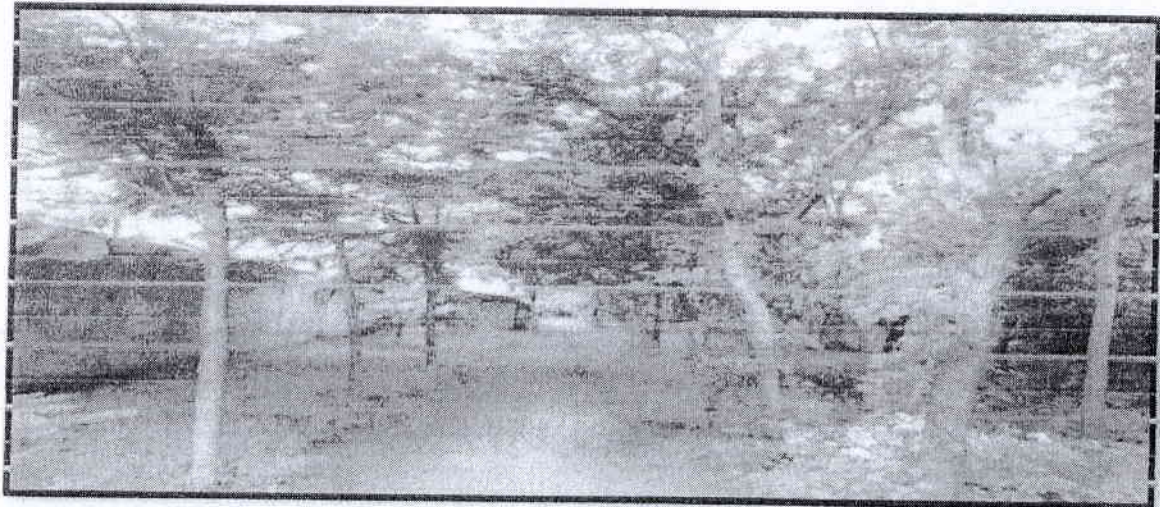


Waf


Near Fly ash Bricks Plant

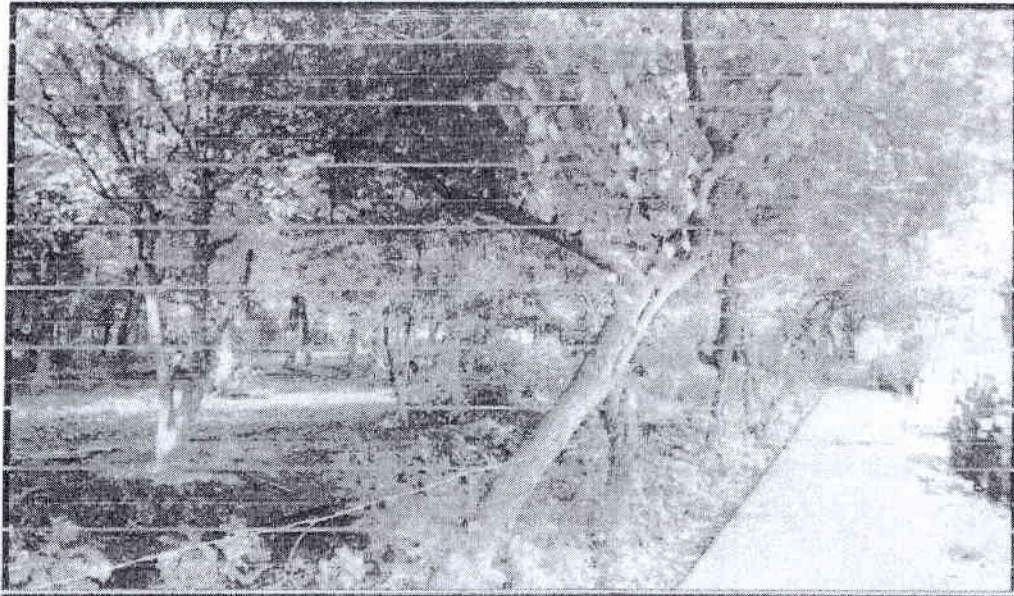

Road side

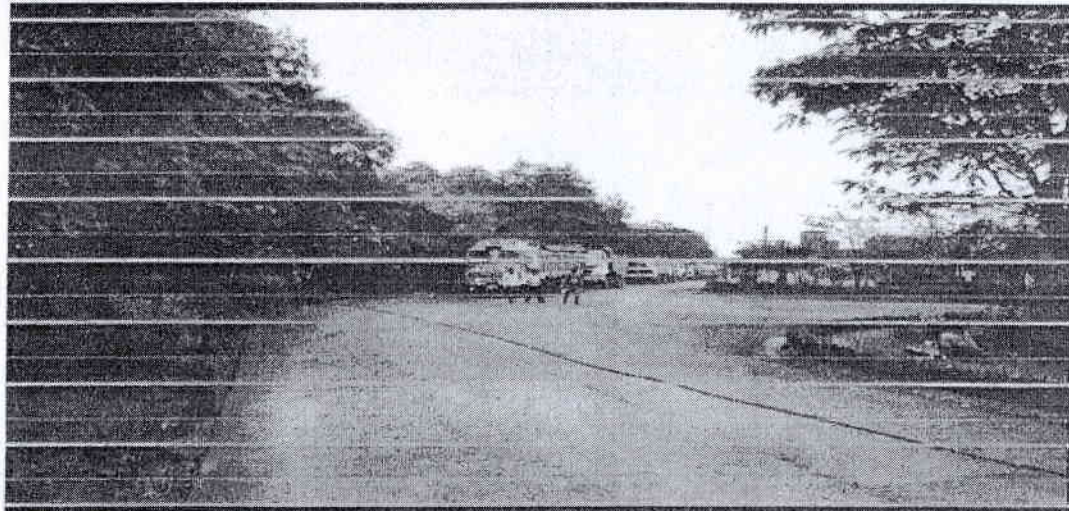

Near Water Reservoir

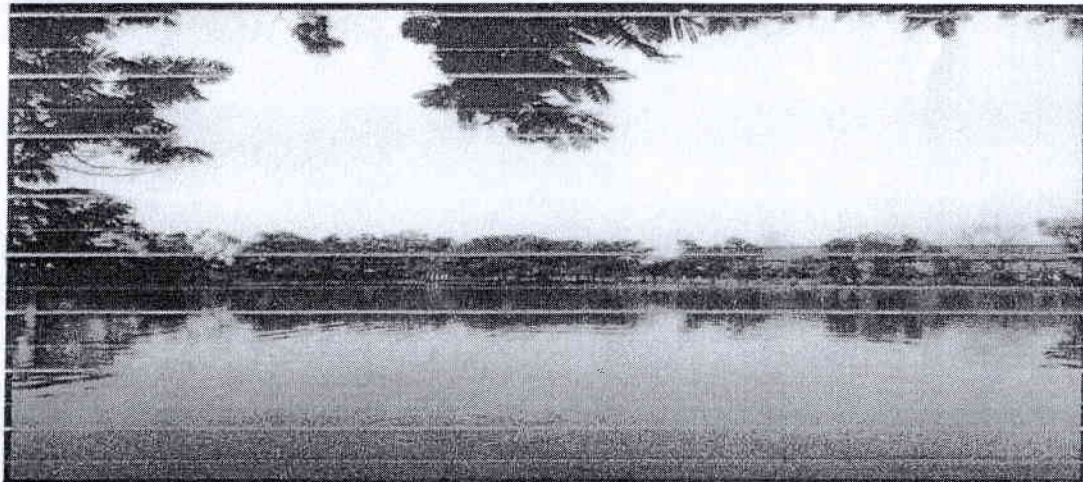

Wol



Relaf

SHRI BAJRANG POWER AND ISPAT LIMITED Raipur, ChhattisgarhStack-1 WHRB And Bio-PP Boiler POLLUTANT(S)  All  Custom

01-Mar-2025 - 25-Mar-2025

AVG: 12 hrs

Go 

Dashboard

Data

Diagnostic

Alerts

 Download1-50 of 50   

Scan Timestamp	NOX (mg/Nm3)	PM (mg/Nm3)	SO2 (mg/Nm3)
25-Mar-2025 12:00:01	27.32	28.67	146.75
25-Mar-2025 00:00:01	26.10	26.42	139.45
24-Mar-2025 12:00:01	26.86	29.05	109.66
24-Mar-2025 00:00:01	34.02	27.34	276.77
23-Mar-2025 12:00:01	28.15	27.68	150.17
23-Mar-2025 00:00:01	30.38	26.95	198.74
22-Mar-2025 12:00:01	25.55	25.80	111.70
22-Mar-2025 00:00:01	32.03	26.49	189.50
21-Mar-2025 12:00:01	28.10	28.18	139.25
21-Mar-2025 00:00:01	27.82	28.09	112.18
20-Mar-2025 12:00:01	29.19	29.02	116.75
20-Mar-2025 00:00:01	28.21	27.78	111.09
19-Mar-2025 12:00:01	27.82	29.65	114.58
19-Mar-2025 00:00:01	22.27	26.85	106.53
18-Mar-2025 12:00:01	28.70	29.59	162.32
18-Mar-2025 00:00:01	32.74	24.58	201.69
17-Mar-2025 12:00:01	29.83	28.11	166.33
17-Mar-2025 00:00:01	29.44	25.42	157.15
16-Mar-2025 12:00:01	-	-	-
16-Mar-2025 00:00:01	29.40	27.34	154.06
15-Mar-2025 12:00:01	30.81	28.25	158.77
15-Mar-2025 00:00:01	37.10	23.79	230.27
14-Mar-2025 12:00:01	39.40	28.64	243.71
14-Mar-2025 00:00:01	33.46	25.05	203.57
13-Mar-2025 12:00:01	37.56	27.15	224.56
13-Mar-2025 00:00:01	32.47	27.00	197.69
12-Mar-2025 12:00:01	31.68	28.80	185.72
12-Mar-2025 00:00:01	32.65	23.91	200.82
11-Mar-2025 12:00:01	35.49	27.83	217.90
11-Mar-2025 00:00:01	35.57	23.84	214.75
10-Mar-2025 12:00:01	39.68	23.46	247.63
10-Mar-2025 00:00:01	36.01	24.72	217.02
09-Mar-2025 12:00:01	36.47	25.10	218.43
09-Mar-2025 00:00:01	31.19	26.36	189.14
08-Mar-2025 12:00:01	33.60	25.90	193.78
08-Mar-2025 00:00:01	33.60	23.57	203.33
07-Mar-2025 12:00:01	31.75	22.80	169.59
07-Mar-2025 00:00:01	30.80	21.91	171.10
06-Mar-2025 12:00:01	31.69	23.82	179.98
06-Mar-2025 00:00:01	29.35	22.54	159.26
05-Mar-2025 12:00:01	30.85	25.77	165.77
05-Mar-2025 00:00:01	30.07	25.07	176.59
04-Mar-2025 12:00:01	32.58	29.59	186.46
04-Mar-2025 00:00:01	30.02	24.27	173.08
03-Mar-2025 12:00:01	33.50	26.46	171.01
03-Mar-2025 00:00:01	33.43	25.18	168.96
02-Mar-2025 12:00:01	37.78	25.75	232.21
02-Mar-2025 00:00:01	35.69	24.97	215.84
01-Mar-2025 12:00:01	37.61	25.73	225.67
01-Mar-2025 00:00:01	34.34	23.24	205.72



POLLUTANT(S) PM Custom

01-Mar-2025 - 25-Mar-2025 AVG: 12 hrs

Go

Dashboard Data Alerts

Download

1-50 of 50

Scan Timestamp	PM (mg/Nm3)
25-Mar-2025 12:00:01	24.65
25-Mar-2025 00:00:01	23.88
24-Mar-2025 12:00:01	22.26
24-Mar-2025 00:00:01	21.04
23-Mar-2025 12:00:01	21.33
23-Mar-2025 00:00:01	19.96
22-Mar-2025 12:00:01	20.38
22-Mar-2025 00:00:01	19.07
21-Mar-2025 12:00:01	21.81
21-Mar-2025 00:00:01	23.66
20-Mar-2025 12:00:01	26.19
20-Mar-2025 00:00:01	26.54
19-Mar-2025 12:00:01	28.76
19-Mar-2025 00:00:01	25.89
18-Mar-2025 12:00:01	23.23
18-Mar-2025 00:00:01	20.83
17-Mar-2025 12:00:01	26.10
17-Mar-2025 00:00:01	28.54
16-Mar-2025 12:00:01	28.28
16-Mar-2025 00:00:01	24.08
15-Mar-2025 12:00:01	23.00
15-Mar-2025 00:00:01	21.51
14-Mar-2025 12:00:01	22.70
14-Mar-2025 00:00:01	21.49
13-Mar-2025 12:00:01	22.08
13-Mar-2025 00:00:01	20.39
12-Mar-2025 12:00:01	21.62
12-Mar-2025 00:00:01	19.90
11-Mar-2025 12:00:01	20.81
11-Mar-2025 00:00:01	19.56
10-Mar-2025 12:00:01	20.65
10-Mar-2025 00:00:01	19.69
09-Mar-2025 12:00:01	21.71
09-Mar-2025 00:00:01	20.96
08-Mar-2025 12:00:01	22.69
08-Mar-2025 00:00:01	21.24
07-Mar-2025 12:00:01	22.62
07-Mar-2025 00:00:01	20.17
06-Mar-2025 12:00:01	21.86
06-Mar-2025 00:00:01	20.81
05-Mar-2025 12:00:01	22.44
05-Mar-2025 00:00:01	21.88
04-Mar-2025 12:00:01	21.40
04-Mar-2025 00:00:01	19.22
03-Mar-2025 12:00:01	20.15
03-Mar-2025 00:00:01	19.22
02-Mar-2025 12:00:01	20.14
02-Mar-2025 00:00:01	19.03
01-Mar-2025 12:00:01	20.11
01-Mar-2025 00:00:01	19.26

Handwritten signature

POLLUTANT(S) PM ▾

Custom ▾

01-Mar-2025 - 25-Mar-2025

AVG: 12 hrs

Go ▶

Dashboard

Data

Alerts

Download

1-50 of 50 « » 📄

Scan Timestamp	PM (mg/Nm3)
25-Mar-2025 12:00:01	10.52
25-Mar-2025 00:00:01	10.00
24-Mar-2025 12:00:01	10.00
24-Mar-2025 00:00:01	10.03
23-Mar-2025 12:00:01	10.85
23-Mar-2025 00:00:01	10.20
22-Mar-2025 12:00:01	10.98
22-Mar-2025 00:00:01	11.00
21-Mar-2025 12:00:01	11.00
21-Mar-2025 00:00:01	11.00
20-Mar-2025 12:00:01	11.00
20-Mar-2025 00:00:01	11.00
19-Mar-2025 12:00:01	11.00
19-Mar-2025 00:00:01	11.00
18-Mar-2025 12:00:01	11.00
18-Mar-2025 00:00:01	11.01
17-Mar-2025 12:00:01	11.00
17-Mar-2025 00:00:01	11.00
16-Mar-2025 12:00:01	11.00
16-Mar-2025 00:00:01	11.00
15-Mar-2025 12:00:01	11.00
15-Mar-2025 00:00:01	11.00
14-Mar-2025 12:00:01	11.00
14-Mar-2025 00:00:01	11.00
13-Mar-2025 12:00:01	11.00
13-Mar-2025 00:00:01	11.00
12-Mar-2025 12:00:01	11.00
12-Mar-2025 00:00:01	11.00
11-Mar-2025 12:00:01	11.00
11-Mar-2025 00:00:01	11.00
10-Mar-2025 12:00:01	11.00
10-Mar-2025 00:00:01	11.00
09-Mar-2025 12:00:01	11.00
09-Mar-2025 00:00:01	11.00
08-Mar-2025 12:00:01	10.65
08-Mar-2025 00:00:01	10.00
07-Mar-2025 12:00:01	10.33
07-Mar-2025 00:00:01	10.26
06-Mar-2025 12:00:01	10.99
06-Mar-2025 00:00:01	10.87
05-Mar-2025 12:00:01	11.00
05-Mar-2025 00:00:01	11.00
04-Mar-2025 12:00:01	11.00
04-Mar-2025 00:00:01	11.00
03-Mar-2025 12:00:01	11.00
03-Mar-2025 00:00:01	11.00
02-Mar-2025 12:00:01	11.00
02-Mar-2025 00:00:01	11.00
01-Mar-2025 12:00:01	11.00
01-Mar-2025 00:00:01	11.00



POLLUTANT(S) PM

Custom

01-Mar-2025 - 25-Mar-2025

AVG: 12 hrs

Go

Dashboard

Data

Alerts

Download


1-50 of 50 « »

Scan Timestamp

PM (mg/Nm3)

25-Mar-2025 12:00:01	11.97
25-Mar-2025 00:00:01	11.93
24-Mar-2025 12:00:01	11.83
24-Mar-2025 00:00:01	12.58
23-Mar-2025 12:00:01	10.42
23-Mar-2025 00:00:01	13.81
22-Mar-2025 12:00:01	13.58
22-Mar-2025 00:00:01	18.13
21-Mar-2025 12:00:01	30.34
21-Mar-2025 00:00:01	29.18
20-Mar-2025 12:00:01	28.54
20-Mar-2025 00:00:01	28.65
19-Mar-2025 12:00:01	25.56
19-Mar-2025 00:00:01	25.72
18-Mar-2025 12:00:01	25.76
18-Mar-2025 00:00:01	28.66
17-Mar-2025 12:00:01	35.30
17-Mar-2025 00:00:01	37.03
16-Mar-2025 12:00:01	39.26
16-Mar-2025 00:00:01	39.64
15-Mar-2025 12:00:01	36.84
15-Mar-2025 00:00:01	33.97
14-Mar-2025 12:00:01	32.26
14-Mar-2025 00:00:01	30.34
13-Mar-2025 12:00:01	26.74
13-Mar-2025 00:00:01	-
12-Mar-2025 12:00:01	-
12-Mar-2025 00:00:01	-
11-Mar-2025 12:00:01	-
11-Mar-2025 00:00:01	43.00
10-Mar-2025 12:00:01	42.00
10-Mar-2025 00:00:01	39.00
09-Mar-2025 12:00:01	39.50
09-Mar-2025 00:00:01	37.00
08-Mar-2025 12:00:01	36.00
08-Mar-2025 00:00:01	33.00
07-Mar-2025 12:00:01	32.50
07-Mar-2025 00:00:01	32.10
06-Mar-2025 12:00:01	31.46
06-Mar-2025 00:00:01	31.75
05-Mar-2025 12:00:01	37.42
05-Mar-2025 00:00:01	43.21
04-Mar-2025 12:00:01	45.54
04-Mar-2025 00:00:01	44.88
03-Mar-2025 12:00:01	46.83
03-Mar-2025 00:00:01	47.24
02-Mar-2025 12:00:01	45.46
02-Mar-2025 00:00:01	43.73
01-Mar-2025 12:00:01	41.58
01-Mar-2025 00:00:01	38.31

TEST REPORT


VIBRANT

Sample Number: "Creating the unimaginable"

Name & Address of the Party

VTL/AA/01-04

M/s SHRI BAJRANG POWER AND ISPAT LTD.
VILL- Borjhara, Urla- Guma Road, Urla
Growth Center, Raipur, Chhattisgarh, 493221

Report No.:

VTL/A/2411300001-04

Format No.:

7.8 F 02

Party Reference No.:

NIL

Report Date:

05/12/2024

Period of Analysis:

30/11/2024-05/12/2024

Receipt Date

30/11/2024

Sample Description : Ambient Air Quality Monitoring

General Information:-

Date of Sampling

: 25-26/11/2024

Sample collected by

: VTL Team

Instrument Calibration Status

: Calibrated

Meteorological condition during monitoring

: Clear sky

Surrounding Activity

: Human, Vehicular & Other Activities

Scope of Monitoring

: Regulatory Requirement

Sampling & Analysis Protocol

: IS-5182 & CPCB Guidelines

Latitude

: 21.487669

Longitude

: 81.769348

Sampling Duration

: 24 hrs.

Parameter Required

: As Per Work Order

Sr.	Sampling Location	PM 10 ($\mu\text{g}/\text{m}^3$)	PM 2.5 ($\mu\text{g}/\text{m}^3$)	NO ₂ ($\mu\text{g}/\text{m}^3$)	SO ₂ ($\mu\text{g}/\text{m}^3$)	CO (mg/m^3)
1.	Near Admin Office	62.94	29.72	19.26	15.35	0.40
2.	Near Main Gate	68.56	33.85	23.59	16.74	0.53
3.	Near Rolling Mill	75.42	36.91	21.41	18.48	0.62
4.	Near Ferro Alloys	81.29	39.69	26.12	20.96	0.74
Limit		100	60	80	80	4
Protocol		IS:5182 (P-23)2006, RA 2017	IS:5182 (P-24)2019	IS:5182 (P-6)2006	IS:5182 (P-2)2001	IS:5182 (P-10)NDIR

-----End of the Report-----


 Checked By

 RK Yadav
 Lab Incharge
 Authorized Signatory
 

Approved & Certified

EPA 1986 Recognised, ISO:9001 and OHSAS:45001 Certified

Vibrant Techno Lab Pvt. Ltd.

SC-40, 3rd Floor, Narayan Vihar S, Ajmer Road Jaipur Raj, 302020

9929108691, 9810205356, 8005707098, 9549956601

0141-2954638

bd@vibranttechnolab.com

www.vibranttechnolab.com

Sample Number: VTL/ N/01-04
Name & Address of Party: M/s SHRI BAJRANG POWER AND ISPAT LTD.
VILL- Borjhara, Urla- Guma Road, Urla Growth
Center, Raipur, Chhattisgarh, 493221

Report No.: VTL/N/2411300001-04
Format No.: 7.8 F-04
Party Reference No.: NIL
Report Date: 05/12/2024

Sample Description: Ambient Noise Level Monitoring

Receipt Date: 30/11/2024

General Information:-

Sample collected by : VTL Team
Instrument Used : Sound Level Meter
Instrument Calibration Status : Calibrated
Instrument Code : VTL/SLM/01-04
Meteorological condition during monitoring : Clear Sky
Scope of Monitoring : Regulatory Requirement
Sampling & Analysis Protocol : IS 9989-1981 RA: 2020
Parameter Required : As per Work Order

S. No.	Location	Date	Test Parameter	Test Result dB (A)	
				Day Time	Night Time
1.	Near Admin Building	25-26/11/2024	Leq	58.2	49.3
2.	Near Main Gate	25-26/11/2024	Leq	62.4	53.7
3.	Near Power Plant	25-26/11/2024	Leq	66.7	52.9
4.	Raw Material Yard	25-26/11/2024	Leq	60.9	54.2

Category of Zones	Leq in dB (A)	
	Day	Night
Industrial	75	70
Commercial	65	55
Residential	55	45
Silence Zone	50	40

1. Day Time is from 6.00 AM to 10.00 PM.
2. Night Time is reckoned between 10.00 PM to 6.00 AM.
3. Silence Zone is defined as an area up to 100 m around premises of Hospitals, Educational and Courts. Use of vehicle horn, Loudspeaker and bursting of crackers is banned in these zones.
Note: Mixed categories of areas be declared as one of the four above mentioned categories by the competent Authority and the corresponding standards shall apply

Checked By



RK Yadav
Lab Incharge
Authorized Signatory

Approved & Certified EPA 1986 Recognised, ISO:9001 and OHSAS:45001 Certified

Vibrant Techno Lab Pvt. Ltd.

SC-40, 3rd Floor, Narayan Vihar S. Ajmer Road, Jaipur Raj. 302020

9929108691, 9810205356, 8005707098, 9549956601

0141-2954638

bd@vibranttechnolab.com

www.vibranttechnolab.com

FORM 21
(Prescribed under Rule(19)1
Health Register

(In respect person employed in occupations declared to be dangerous operation under section 87)

Name of Worker..... Ashok kumar Age/Sex... 28
Name of Company:- Bajrang Power Employee Code
Nature of occupation Date - 18/11/2024

Annexure
PRE-EMPLOYMENT & PERIODIC MEDICAL EXAMINATION

(1) GENERAL EXAMINATION:

Height 169 cm Weight 66 kg BMI
Chest Inspiration cm Expiration cm
Throat NO Tongue NO Tonsils NO Teeth NO
Gums NO Thyroid NO
Lymph nodes: NO
Additional finding: NO

(2) CARDIO-VASCULAR SYSTEM:

Pulse:mt. Regular/Irregular Peripheral Pulse-felt/not felt
BP 110/70 min of Hg Heart Sound : ... NORMAL/ABNORMAL....
Murmur, If any - ... NO Additional finding (s), if any NO

(3) RESPIRATORY SYSTEM:

Shape of Chest: ... Tubular Chest movements: Symmetrical
Trachea Centrally Breath sound - Vesicular

(5) GASTRO-INTESTINAL SYSTEM:

Liver NP Spleen NP
Any abdominal lumps: NO/YES

(6) EXAMINATION OF EYES .:

External Exam NORMAL/ABNORMAL Squint: YES/NO
Nystagmus : YES/NO Fundus L / R
Night Blindness YES/NO
Colour vision - Normal / Defective
Individual colour identification- Normal / Defective
Distance vision (without glasses) Right 6/6 Left 6/6
(with glasses) Right Left
Near-vision (without glasses) Right N/6 Left N/6
(with glasses) Right Left

(6) EXAMINATION OF EAR, NOSE & THROAT:

External Examination: NAD

(7) GENITO URINARY SYSTEM:

Hernia - .. YES/NO Hydrocele - .. YES/NO Varicocele - .. YES/NO
Cryptorchidism- YES/NO Phimosis YES/NO Varicose veins- YES/NO
Signs of STD ... YES/NO

Other Examinations For Females :

Menarche yr. G. Para Menstrual irregularity if any

INVESTIGATIONS

(8) Lab Investigations:

Haemogram B Rh factor Negative Hb 14.0 gm%
 RBC 4.2 Platelets Count 251 TLC 5800
 DLC:- P 65 L 31 E 01 M 03 B 00

Renal profile

Blood Urea : 25.0 S. Creatinine : 0.84

Hepatic profile - SGOT 27 SGPT 23 Alkaline Phosphate 87 S. Bilirubin

Lipid profile :

Serum Cholesterol 148 Triglycerides 126 HDL 40 LDL 82.8
Metabolic 94.5 Blood Sugar PP S. Uric Acid 4.81

Urine: Albumin Nil Sugar Nil Microscopy Nil.
 Stool :

(10) Other Investigation

X-Ray Chest. PA

(In normal person once in three year), (in case of any abnormality x-ray can be done at shorter intervals)

ECG-

(In case of any abnormality further test should be carried out)

Ultra Sound- Whole abdomen (in normal person once in three years in case of any abnormality can be done at shorter interval)

Other

(10) Pulmonary Function Test

	FCV	FEV 1	FEV 1/FVC
PREDICATED	02.50	02.13	25.20
MEASURED	02.10	02.00	95.24
% OF PREDICATED	084.	094.	112.

Remark-

(11) Audiometry examination

PTA	Lt. Ear	16.6	Rt. Ear	16.6
Remark	BIL Hearing sensitivity.			

PTA of both ears at frequency 150,250,500,1000,2000,4000,8000 Cycles/sec

(12) Medical examination of canteen staff

- Blood examination for venereal disease and routine blood examination
- Stool and urine examination for worm infection
- Screening for skin diseases (scabies and others)
- X-ray and other tests for T. B.

13. Details of Other specific medical examination carried out as mentioned in the respective schedules of r

107 B.C. & Factory rules 1962-

Dr. Avinash Pathak

Reg. No. CGMC 5402/2015

Medical Officer

Signature (with date) of
 Factory Medical Officer



Signature (with date)
 Certifying surgeon

APOLLO

DIAGNOSTIC CENTRE

DATE 18-11-24
NAME : MR ASHOK KUMAR
AGE / SEX 28Y/M
COMPANY : BAJRANG ALLIANCE

AUDIOGRAM

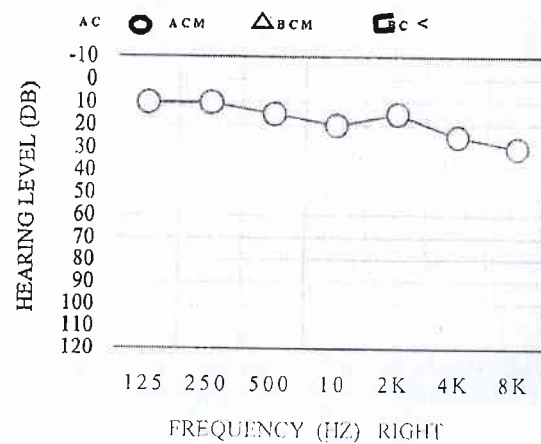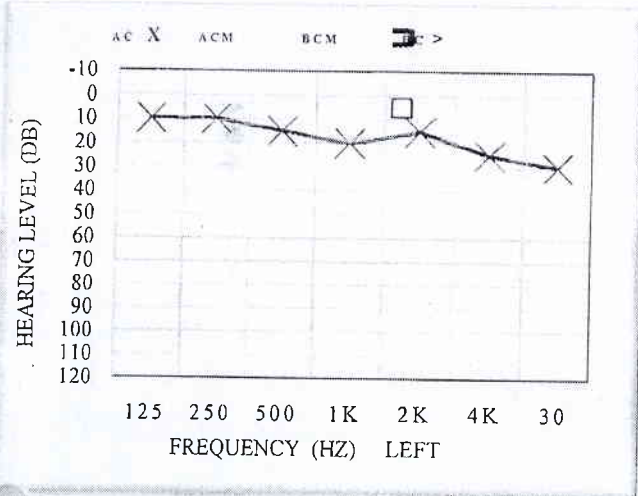


EAR	MODE	AIR CONDUCTION		BONE CONDUCTION		COLOUR CODE	THRESHHOLD IN dB		LEFT	RIGHT
		MASKED	UNMASKED	MASKED	UNMASKED		AIR CONDUCTION			
LEFT		□	×	◡	>	BLUE	BONE CONDUCTION		16.66666667	16.66667
RIGHT		△	○	◣	<	RED	SPEECH			
NO RESPONSE : ADD ↓BELOW THE RESPECTIVE SYMBOLS										

REMARK : B/L . NORMAL HEARING SENSITIVITY

Surbhi
Dr. SURBHI CHOPRA
(CHATUR MONTA)
M.S. ENT, HEAD & Neck Surgery
Reg. No.-G-64958

APOLLO DIAGNOSTIC CENTRE RAIPUR (C.G.)

111114819: MR ASHOK KUMAR, Male; 28 Yrs 00 Mths
Ref: BAURANG POWER; Date: 18-11-2024 (14:23:00) Notch: 50 Hz; 0.05 Hz - 100 Hz; 10.0 mm/mV 25 mm/s; Page: 1 of 1
P-QRS-T Axis 71-50-26 (Deg)
QT/QTc: 337/339ms
PR Interval: 108 ms
QRS Duration: 126 ms

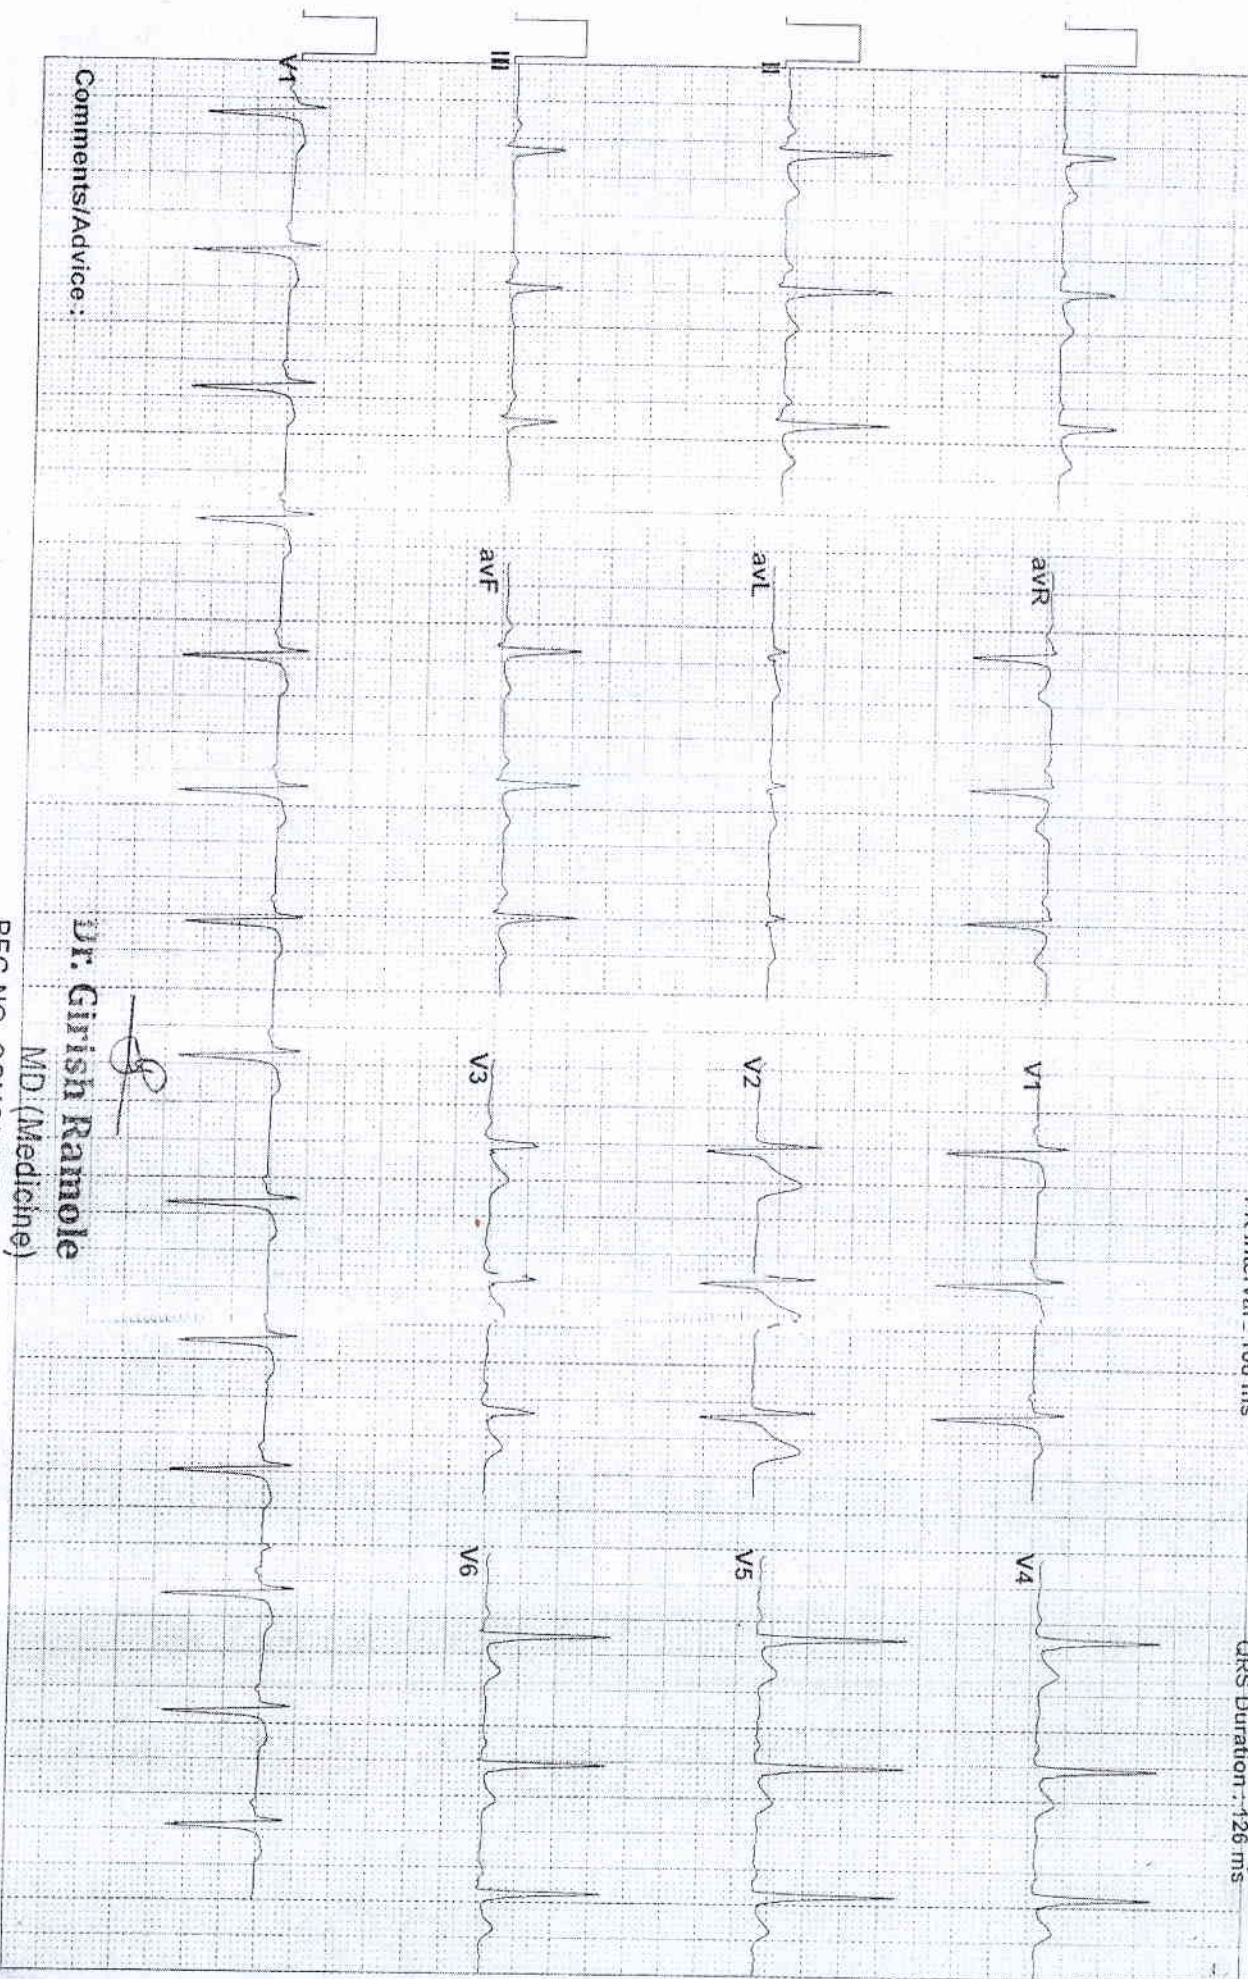

Comments/Advice :

[Signature]

Dr. Girish Ramole

MD (Medicine)

REG.NO.-CGMC/1738/2008

24x7

POLLO

DIAGNOSTIC CENTRE



PATIENT NAME : Mr. ASHOK KUMAR

DATE : 18/11/2024

AGE / SEX : 28 Y / Male

UHID NO : 2024181122446

REF DR. : BAJRANG POWER

पोलो डायग्नोस्टिक सेंटर, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.) 4020988, 4017888

उपलब्ध सुविधाएँ

BIO CHEMISTRY

* 3.0 T एम.आर.आई (साईलेंट)

* 96 स्लाईस होल बॉडी

स्पाइरल सी.टी.स्कैन

* लिथोट्रिप्सी ESWL

(लेजर द्वारा पथरी का इलाज)

* मास्टर हेल्थ चेकअप

* होल बॉडी कलर

सोनोग्राफी (5D)

* लीवर, ब्रेस्ट एवं थायराईड

इलास्टोग्राफी

* वेस्कुलर डापलर

* डिजीटल एक्स-रे

* डिजीटल पोर्टेबल एक्स-रे

* डिजीटल OPG एक्स-रे

डिजीटल मेमोग्राफी

* कलर डापलर इकोकार्डियोग्राफी

* कम्प्यूटराईज्ड TMT, ई.सी.जी.

* (लॉजी)

* FNAC सायटोलॉजी

* कम्प्यूटराईज्ड ई.ई.जी.

EMG, NCV,

* स्पाइरोमीटर (PFT)

* AMNIOCENTESIS

* C.V.S.

(Chorionic Villus Sampling)

PARAMETERS

RESULT

UNIT

REFERENCE VALUES

Urea

25.0

mg/dl

15 - 45

Creatinine

0.84

mg/dl

0.6 - 1.4

Uric Acid

4.81

mg/dl

3.6-7.0

SGOT (AST)

27.0

U/L

0-45

SGPT (ALT)

23.0

U/L

0-45

Alkaline phosphatase (ALP)

87.0

U/L

41-137

Total Cholesterol

148.0

mg/dl

Desirable <200
Borderline high 200-239
High >240

Triglycerides

126.0

mg/dl

Desirable <150
Borderline high 151-199
High 200-499
Very high >500

HDL Cholesterol

40.0

mg/dl

35-70

VLDL Cholesterol

25.20

mg/dl

7-35

LDL Cholesterol

82.80

mg/dl

Desirable <100
Above desirable 100-129
Borderline high 130-159
High 160-189
Very high >190

GLUCOSE RANDOM

94.55

mg/dl

80-140



For appointment :

91934 89000, 91934 86000

Note - Please Correlate Clinically

Page 1 of 3

* Skin Treatment

* Laser Treatment

* Hair Growth Treatment

3.0T एम.आर.आई (साईलेंट)

पथरी का इलाज (लिथोट्रिप्सी)

एम्बुलेंस सेवा उपलब्ध

स्किन एंड लेजर ट्रीटमेंट

For-MRI, CT Scan Emergency- 9630898682, 9926892536

For appointment 0771 - 4017888, 4020988

POLLO
STONE
CLINIC

जर्मनी से आयातित अत्याधुनिक सर्वश्रेष्ठ रीमर्स लिथोट्रिप्सी मशीन एवं डार्नियर लिथोट्रिप्सी मशीन द्वारा किडनी(गुर्दे), यूरैटर(पेशाबनली), पेशाब थैली(ब्लैडर), पित्तनली एवं पैनक्रियाज ग्रंथी में पथरी का उपचार बगैर ऑपरेशन, बिना भर्ती, बेहोशी, चीरफाड़ के उपलब्ध पूरे उपचार का रियायती दरों का पैकेज भी उपलब्ध।

पोलो स्टोन क्लीनिक, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.)

फोन-4020988, 4017888

PATIENT NAME : Mr. ASHOK KUMAR

DATE : 18/11/2024

AGE / SEX : 28 Y / Male

UHID NO : 2024181122446

REF DR. : BAJRANG POWER

पोलो डायग्नोस्टिक सेंटर, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.) 4020988, 4017888

उपलब्ध सुविधाएँ

- * 3.0 T एम.आर.आई (साईलेंट)
- * 96 स्लाइस होल बॉडी
स्पाइरल सी.टी.स्कैन
- * लिथोट्रिप्सी ESWL
(किनेज द्वारा पथरी का इलाज)
- * मास्टर हेल्थ चेकअप
- * होल बॉडी कलर
सोनोग्राफी (5D)
- * लीवर, ब्रेस्ट एवं थायराईड
इलास्टोग्राफी
- * वेस्कुलर डापलर
- * डिजीटल एक्स-रे
- * डिजीटल पोर्टेबल एक्स-रे
- * डिजीटल OPG एक्स-रे
- * डिजीटल मेमोग्राफी
- * कलर डापलर इकोकार्डियोग्राफी
- * कम्प्यूटराईज्ड TMT, ई.सी.जी.
चेकड BY
- * एलॉजी
- * FNAC सायटोलॉजी
- * कम्प्यूटराईज्ड ई.ई.जी.
EMG, NCV,
- * स्पाइरोमीटर (PFT)
- * AMNIOCENTESIS
- * C.V.S.
(Chorionic Villus Sampling)

HAEMATOLOGY

PARAMETERS	RESULT	UNIT	REFERENCE VALUES
ABO Group	" B "		
Rh Type	Negative		
Total WBC Count	5800	/cumm	4500-11000
Total RBC	4.28	10 ⁶ /μl	4.00 - 5.60
Haemoglobin	14.0	g/dl	12.5-17.0
Platelet Count	251	10 ³ /μl	150-400
Neutrophils	65	%	40 - 75
Lymphocytes	31	%	20 - 40
Eosinophils	01	%	1 - 6
Monocytes	03	%	1 - 10
Basophils	00	%	0 - 1

--- End Of Report ---

DR. S.CHATTERJEE
D.C.P.D.N.B.F.
CON. PATHOLOGIST



For appointment :
91934 89000, 91934 86000

Note - Please Correlate Clinically

Page 3 of 3

- * Skin Treatment
- * Laser Treatment
- * Hair Growth Treatment

3.0T एम.आर.आई (साईलेंट)

पथरी का इलाज (लिथोट्रिप्सी)

एम्बुलेंस सेवा उपलब्ध

स्किन एंड लेजर ट्रीटमेंट

For-MRI, CT Scan Emergency- 9630898682, 9926892536

For appointment 0771 - 4017888, 4020988



जर्मनी से आयातित अत्याधुनिक सर्वश्रेष्ठ सीमेंस लिथोट्रिप्सी मशीन एवं डार्नियर लिथोट्रिप्सी मशीन द्वारा किडनी(गुर्दे), यूरैटर(पेशाबनली), पेशाब थैली(ब्लैडर), पित्तगली एवं पैनक्रियाज ग्रंथी में पथरी का उपचार बगैर ऑपरेशन, बिना भर्ती, बेहोशी, चीरफाड़ के उपलब्ध पूरे उपचार का रियायती दरों का पैकेज भी उपलब्ध।

पोलो स्टोन क्लीनिक, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.)
फोन-4020988, 4017888

PATIENT NAME : Mr. ASHOK KUMAR

DATE : 18/11/2024

AGE / SEX : 28 Y / Male

UHID NO : 2024181122446

REF DR. : BAJRANG POWER

पोलो डायग्नोस्टिक सेंटर, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.) 4020988, 4017888

उपलब्ध सुविधाएँ

- 3.0 T एम.आर.आई (साईलेंट)
- 96 स्लाइस होल बॉडी
स्पाइरल सी.टी.स्कैन
- लिथोट्रिप्सी ESWL
(पेसर द्वारा पथरी का इलाज)
- मास्टर हेल्थ चेकअप
- होल बॉडी कलर
सोनोग्राफी (5D)
- लीवर, ब्रेस्ट एवं थायराईड
इलास्टोग्राफी
- वेस्कुलर डापलर
- डिजीटल एक्स-रे
- डिजीटल पोर्टेबल एक्स-रे
- डिजीटल OPG एक्स-रे
- डिजीटल मेमोग्राफी
- कलर डापलर इकोकार्डियोग्राफी
- कम्प्यूटराईज्ड TMT. ई.सी.जी.
- () लॉजी
- FNAC सायटोलॉजी
- कम्प्यूटराईज्ड ई.ई.जी.
- EMG, NCV,
- स्पाइरोमीटर (PFT)
- AMNIOCENTESIS
- C.V.S.
(Chorionic Villus Sampling)

CLINICAL PATHOLOGY

PARAMETERS RESULT UNIT REFERENCE VALUES

URINE ROUTINE AND MICROSCOPY / URINOGRAM

Physical Examination

COLOUR	Pale yellow		
QUANTITY	30	ml	>30
APPEARANCE	Clear	-	Clear
REACTION	Acidic	-	Acidic

CHEMICAL EXAMINATION

ALBUMIN.	Nil	-	NIL
SUGAR	Nil	%	NIL

MICROSCOPY EXAMINATION

RBC	Nil	/hpf	NIL
PUS CELLS	2-3	/hpf	<5
EPITHELIAL CELLS	1-2	/hpf	<3
CRYSTALS	Absent	-	Absent
CASTS	Absent	-	Absent
BACTERIA	Absent	-	Absent

Others(Urine)



For appointment :
91934 89000, 91934 86000

- Skin Treatment
- Laser Treatment
- Hair Growth Treatment

Note - Please Correlate Clinically

Page 2 of 3

3.0T एम.आर.आई (साईलेंट)

पथरी का इलाज (लिथोट्रिप्सी)

एम्बुलेंस सेवा उपलब्ध

स्किन एंड लेजर ट्रीटमेंट

For-MRI, CT Scan Emergency- 9630898682, 9926892536

For appointment 0771 - 4017888, 4020988



POLLO
STONE
CLINIC

जर्मनी से आयातित अत्याधुनिक सर्वश्रेष्ठ सीमेंस लिथोट्रिप्सी मशीन एवं डार्नियर लिथोट्रिप्सी मशीन द्वारा किडनी(गुर्दे), यूरेटर(पेशाबनली), पेशाब थैली(ब्लैडर), पित्तनली एवं पेनक्रियाज ग्रंथी में पथरी का उपचार बगैर ऑपरेशन, बिना भर्ती, बेहोशी, चीरफाड़ के उपलब्ध पूरे उपचार का रियायती दरों का पैकेज भी उपलब्ध।

पोलो स्टोन क्लीनिक, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.)
फोन-4020988, 4017888

Pt. Name: MR ASHOK KUMAR

SEX -M

Ref by :BAJRANG POWER

DATE-18.11.2024

पोलो डायग्नोस्टिक सेंटर, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.) 4020988, 4017888

उपलब्ध सुविधाएँ

- 3.0 T एम.आर.आई. (साईलेंट)
- 96 स्लाईस होल बॉडी
स्पाइरल सी.टी.स्कैन
- लिथोट्रिप्सी ESWL
(पथरी का इलाज)
- मास्टर हेल्थ चेकअप
- होल बॉडी कलर
सोनोग्राफी (5D)
- लीवर, ब्रेस्ट एवं थायराईड
इलास्टोग्राफी
- वेस्कुलर डापलर
- डिजीटल एक्स-रे
- डिजीटल पोर्टेबल एक्स-रे
- डिजीटल OPG एक्स-रे
- डिजीटल मेमोग्राफी
- कलर डापलर इकोकार्डियोग्राफी
- कम्प्यूटराईज्ड TMT, ई.सी.जी.
- (लॉजी)
- FNAC सायटोलॉजी
- कम्प्यूटराईज्ड ई.ई.जी.
- EMG, NCV,
- स्पाइरोमीटर (PFT)
- AMNIOCENTESIS
- C.V.S.
(Chorionic Villus Sampling)

ULTRASONOGRAPHY OF WHOLE ABDOMEN

**DONE BY MOST ADVANCED LIVE 4 - D- RS-80A (SAMSUNG)
WHOLE BODY COLOUR DOPPLER MACHINE**

LIVER :- Appears normal in size and outline with normal homogenous echotexture.
No focal parenchymal lesion seen.. Intrahepatic biliary radicles are not dilated, no calculi seen.

GALL BLADDER:- Appears normal in size, shape and gall bladder stone with polyps in lumen.

PV AND CBD:-Measurements are within normal limits. No calculi shadow seen in CBD.

PANCREAS :-Shows normal homogenous echotexture. No focal parenchymal Lesion seen.

BOTH KIDNEY:-Both kidneys appears normal in size, shape & echotexture,
No focal parenchymal lesion seen. No evidence of stone, hydronephrosis or any mass lesion seen.

SPLEEN :- Appears normal in size, shape & echotexture.

URINARY BLADDER :-Appears normal in size, shape and wall thickness, No intraluminal pathology seen.

PROSTATE - Is normal in size shape & echotexture.

* No evidence of lymphadenopathies or ascites seen.

IMPRESSION: NORMAL U. S. study.


Dr. Paras Jain
MBBS. DMR
(Consultant Radiologist &
Ultrasonologist)



For appointment :
91934 89000, 91934 86000

- Skin Treatment
- Laser Treatment
- Hair Growth Treatment

3.0T एम.आर.आई. (साईलेंट)

पथरी का इलाज (लिथोट्रिप्सी)

एम्बुलेंस सेवा उपलब्ध

स्किन एंड लेजर ट्रीटमेंट

For-MRI, CT Scan Emergency- 9630898682, 9926892536

For appointment 0771 - 4017888, 4020988



**POLLO
STONE
CLINIC**

जर्मनी से आयातित अत्याधुनिक सर्वश्रेष्ठ सीमेंस लिथोट्रिप्सी मशीन एवं डार्नियर लिथोट्रिप्सी मशीन द्वारा किडनी (गुर्दे), यूरैटर (पेशाबनली), पेशाब थैली (ब्लैडर), पित्तनली एवं पैनक्रियाज ग्रंथी में पथरी का उपचार बगैर ऑपरेशन, बिना भर्ती, बेहोशी, बीरफाड़ के उपलब्ध पूरे उपचार का रियायती दरों का पैकेज भी उपलब्ध।

पोलो स्टोन क्लिनिक, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.)
फोन-4020988, 4017888





APOLLO DIAGNOSTIC CENTRE

DEVENDRA NAGAR RAIPUR

Patient: MR ASHOK KUMAR
Refd. By: BAJRANG POWER
Pred. Eqns: RECORDERS
Date : 18-Nov-2024 02:28 PM

Age : 28 Yrs
Height : 169 Cms
Weight : 66 Kgs
ID : 3928

Gender : Male
Smoker : No
Eth. Corr: 70
Temp :

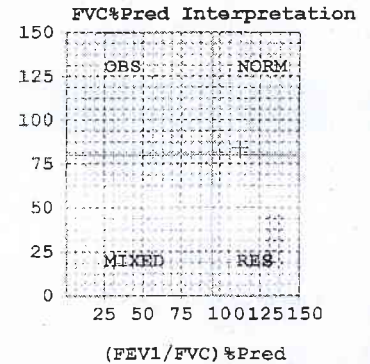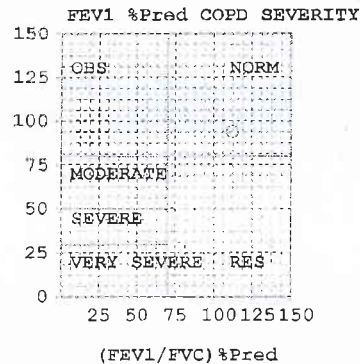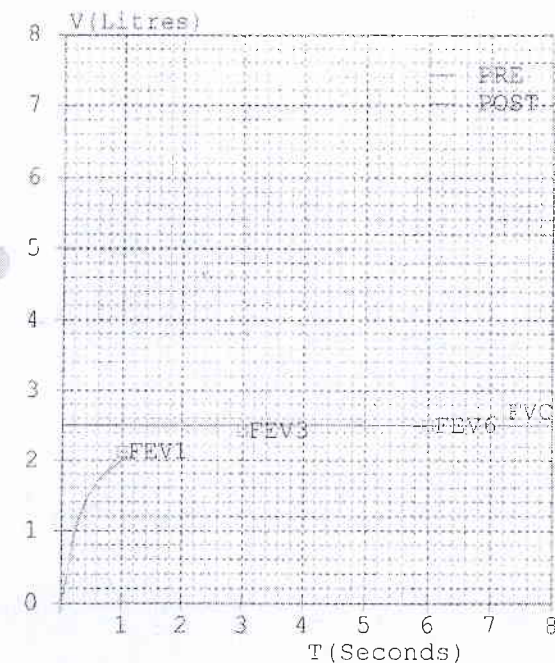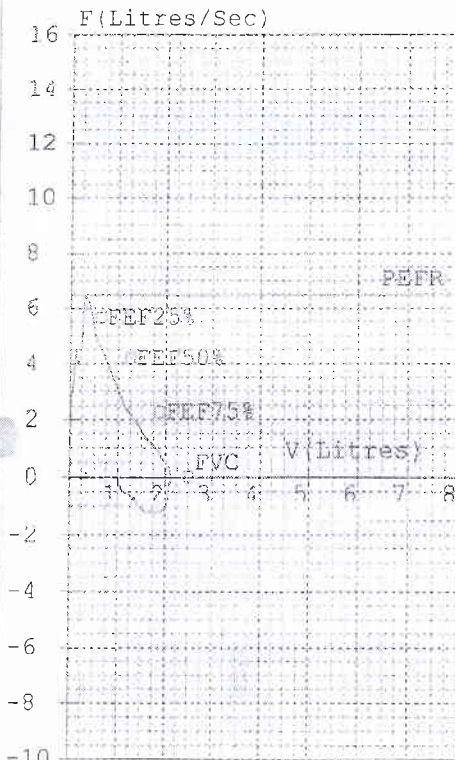

FVC Results

Parameter	Pred	M.Pre	%Pred	M.Post	%Pred	%Imp
FVC	(L) 02.50	02.10	084	-----	---	---
FEV1	(L) 02.13	02.00	094	-----	---	---
FEV1/FVC	(%) 85.20	95.24	112	-----	---	---
FEF25-75	(L/s) 03.12	02.60	083	-----	---	---
PEFR	(L/s) 06.44	06.40	099	-----	---	---
FIVC	(L) -----	01.11	---	-----	---	---
FEV.5	(L) -----	01.56	---	-----	---	---
FEV3	(L) 02.42	02.10	087	-----	---	---
PIFR	(L/s) -----	01.23	---	-----	---	---
FEF75-85	(L/s) -----	01.14	---	-----	---	---
FEF.2-1.2	(L/s) 05.36	03.86	072	-----	---	---
FEF 25%	(L/s) 05.66	05.04	089	-----	---	---
FEF 50%	(L/s) 04.17	02.83	068	-----	---	---
FEF 75%	(L/s) 02.24	01.39	062	-----	---	---
FEV.5/FVC	(%) -----	74.29	---	-----	---	---
FEV3/FVC	(%) 96.80	100.00	103	-----	---	---
FET	(Sec) -----	01.28	---	-----	---	---
ExptTime	(Sec) -----	00.03	---	-----	---	---
Lung Age	(Yrs) 028	030	107	-----	---	---
FEV6	(L) 02.50	-----	---	-----	---	---
FIF25%	(L/s) -----	01.89	---	-----	---	---
FIF50%	(L/s) -----	01.20	---	-----	---	---
FIF75%	(L/s) -----	00.62	---	-----	---	---

Pre Test COPD-Severity

Test within normal limits

Dr. Paras Jain
MBBS, DMR
Regd. No.-3850
Apollo Diagnostic Centre
RAIPUR (C.G.)

Pre Medication Report Indicates

Spirometry within normal limits as (FEV1/FVC)%Pred >95 and FVC%Pred >80

24x7

POLLO

DIAGNOSTIC CENTRE



Pt. Name: MR ASHOK KUMAR

SEX -M

Ref by :BAJRANG POWER

DATE-18.11.2024

पोलो डायग्नोस्टिक सेंटर, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.) ☎ 4020988, 4017888

उपलब्ध सुविधाएँ

- 3.0 T एम.आर.आई (साईलेंट)
- 96 स्लाईस होल बॉडी
स्पाइरल सी.टी.स्कैन
- लिथोट्रिप्सी ESWL
(पथरी द्वारा पथरी का इलाज)
- मास्टर हेल्थ चेकअप
- होल बॉडी कलर
सोनोग्राफी (5D)
- लीवर, ब्रेस्ट एवं थायराईड
इलास्टोग्राफी
- वेस्कूलर डापलर
- डिजीटल एक्स-रे
- डिजीटल पोर्टेबल एक्स-रे
- डिजीटल OPG एक्स-रे
- डिजीटल मेमोग्राफी
- कलर डापलर इकोकार्डियोग्राफी
- कम्प्यूटाइज्ड TMT, ई.सी.जी.
- लॉजी
- FNAC सायटोलॉजी
- कम्प्यूटाइज्ड ई.ई.जी.
EMG, NCV,
- स्पाइरोमीटर (PFT)
- AMNIOCENTESIS
- C.V.S.
(Chorionic Villus Sampling)

X-RAY CHEST PA VIEW

- Both lung fields are clear no active parenchymal lesion seen.
- Both costophrenic angles are clear.
- Cardiothoracic ratio is within normal limits, Cardiac shadow shows no significant abnormality.
- Thoracic bone cage appears normal.
- Diaphragmatic outline are clearly delineated.

IMPRESSION:- Normal Findings.

Dr. Paras Jain
MBBS. DMR
(Consultant Radiologist &
Ultrasonologist)



For appointment :
91934 89000, 91934 86000

- Skin Treatment
- Laser Treatment
- Hair Growth Treatment

3.0T एम.आर.आई (साईलेंट)

पथरी का इलाज (लिथोट्रिप्सी)

एम्बुलेंस सेवा उपलब्ध

स्किन एंड लेज़र ट्रीटमेंट

For-MRI, CT Scan Emergency- 9630898682, 9926892536

For appointment 0771 - 4017888, 4020988



POLLO
STONE
CLINIC

जर्मनी से आयातित अत्याधुनिक सर्यश्रेष्ठ सीमेंस लिथोट्रिप्सी मशीन एवं डार्नियर लिथोट्रिप्सी मशीन द्वारा किडनी(गुर्दे), यूरेटर(पेशाबनली), पेशाब थैली(ब्लैडर), पित्तनली एवं पैनक्रियाज ग्रंथी में पथरी का उपचार बगैर ऑपरेशन, बिना भर्ती, बेहोशी, चीरफाड़ के उपलब्ध पूरे उपचार का रियायती दरों का पैकेज भी उपलब्ध।

पोलो स्टोन क्लीनिक, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.)
फोन-4020988, 4017888

FORM 21
(Prescribed under Rule(19)1
Health Register

(In respect person employed in occupations declared to be dangerous operation under section 87)

Name of Worker Mrs. Kaushya B. B. B. Age/Sex 31y/m
Name of Company - Bajrang Alliance Employee Code
Nature of occupation Date 11/04/2025

Annexure
PRE-EMPLOYMENT & PERIODIC MEDICAL EXAMINATION

(1) GENERAL EXAMINATION:

Height 150 cm, Weight 35 kg, BMI
Chest Inspiration 18 cm, Expiration 14 cm.
Throat (M) Tongue (M) Tonsils (M) Teeth (M)
Gums (M) Thyroid (M)
Lymph nodes NO
Additional finding: NO

(2) CARDIO-VASCULAR SYSTEM:

Pulse: 76 int. Regular/Irregular Peripheral Pulse-felt/not felt
BP 120/80 min of Hg Heart Sound: NORMAL/ABNORMAL
Murmur, If any - NO Additional finding (s), if any NO

(3) RESPIRATORY SYSTEM:

Shape of Chest: Tubular Chest movements: Symmetrical
Trachea Centrally Breath sound - Vesicular

(5) GASTRO-INTESTINAL SYSTEM:

Liver NP Spleen NP
Any abdominal lumps: NO/YES

(6) EXAMINATION OF EYES :

External Exam - NORMAL/ABNORMAL Squint: YES/NO
Nystagmus : YES/NO Fundus L / R
Night Blindness YES/NO
Colour vision - Normal / Defective
Individual colour identification- Normal / Defective

Distance vision (without glasses) Right 6/6 Left 6/6
(with glasses) Right Left
Near-vision (without glasses) Right N/G Left N/G
(with glasses) Right Left

(6) EXAMINATION OF EAR, NOSE & THROAT:

External Examination: NAD

(7) GENITO URINARY SYSTEM:

Hernia - YES/NO Hydrocele - YES/NO Varicocele - YES/NO
Cryptorchidism- YES/NO Phimosis YES/NO Varicose veins- YES/NO
Signs of STD YES/NO

Other Examinations For Females :

Menarche 14 yr. G. Para 1 Menstrual irregularity NO if any

INVESTIGATIONS

(8) Lab Investigations:

Haemogram

Blood Group 0 Rh factor Positive Hb 15.3 gm%
 RBC 5.5 Platelets Count 326 TLC 9782
 DLC :- P 66 L 36 EOL M 03 B 0

Renal profile

Blood Urea : 18.0 S. Creatinine : 0.83

Hepatic profile - SGOT 19.0 SGPT 21 Alkaline Phosphate : 50 S. Bilirubin

Lipid profile :

Serum Cholesterol 142 Triglycerides 123 HDL 38.0 LDL 79.4

Metabolic

Blood Sugar F 96.9 Blood Sugar PP S. Uric Acid 4.40

Urine: Albumin Nil Sugar Nil Microscopy Nil
 Stool :

(10) Other Investigation

X-Ray Chest. PA

(In normal person once in three year), (in case of any abnormality x-ray can be done at shorter intervals)

ECG- (In case of any abnormality further test should be carried out)

Ultra Sound- Whole abdomen (In normal person once in three years in case of any abnormality can be done at shorter interval)

Other

(10) Pulmonary Function Test

	FCV	FEV 1	FEV 1/FVC
PREDICTED	01.51	01.22	80.79
MEASURED	01.96	01.93	98.47
% OF PREDICTED	130	158	122

Remark-

(11) Audiometry examination

PTA	Lt. Ear	18.3	Rt. Ear	18.3
Remark	BIL u Hearing Sensitivity			

PTA of both ears at frequency 150, 250, 500, 1000, 2000, 4000, 8000 Cycles/sec

(12) Medical examination of canteen staff

- (a) Blood examination for venereal disease and routine blood examination
- (b) Stool and urine examination for worm infection
- (c) Screening for skin diseases (scabies and others)
- (d) X-ray and other tests for T. B.

13. Details of Other specific medical examination carried out as mentioned in the respective schedules of r 107 of C.C. (M) Rules 1962

Reg. No. CGMC 6402/ 2015


Medical Officer

Shri Bajrang Power & Ispar Ltd
 Signature (with date) of
 Factory Medical Officer

Signature (with date)
 Certifying surgeon

APOLLO DIAGNOSTIC CENTRE RAIPUR(C. G.)

9849657046: MRS KAUSHILYA PRAJAPATI; Female; 31 Yrs 00 Mths Ht : Cms; Wt: Kgs ; BP : / ; HR :91 bpm
Ref.: BAJRANG ALLIANCE; Date : 11-01-2025(16:40:45) N5ch : 50 Hz ; 0.05 Hz - 100 Hz ; 10.0 mm/mV 25 mm/s Page : 1 of 1

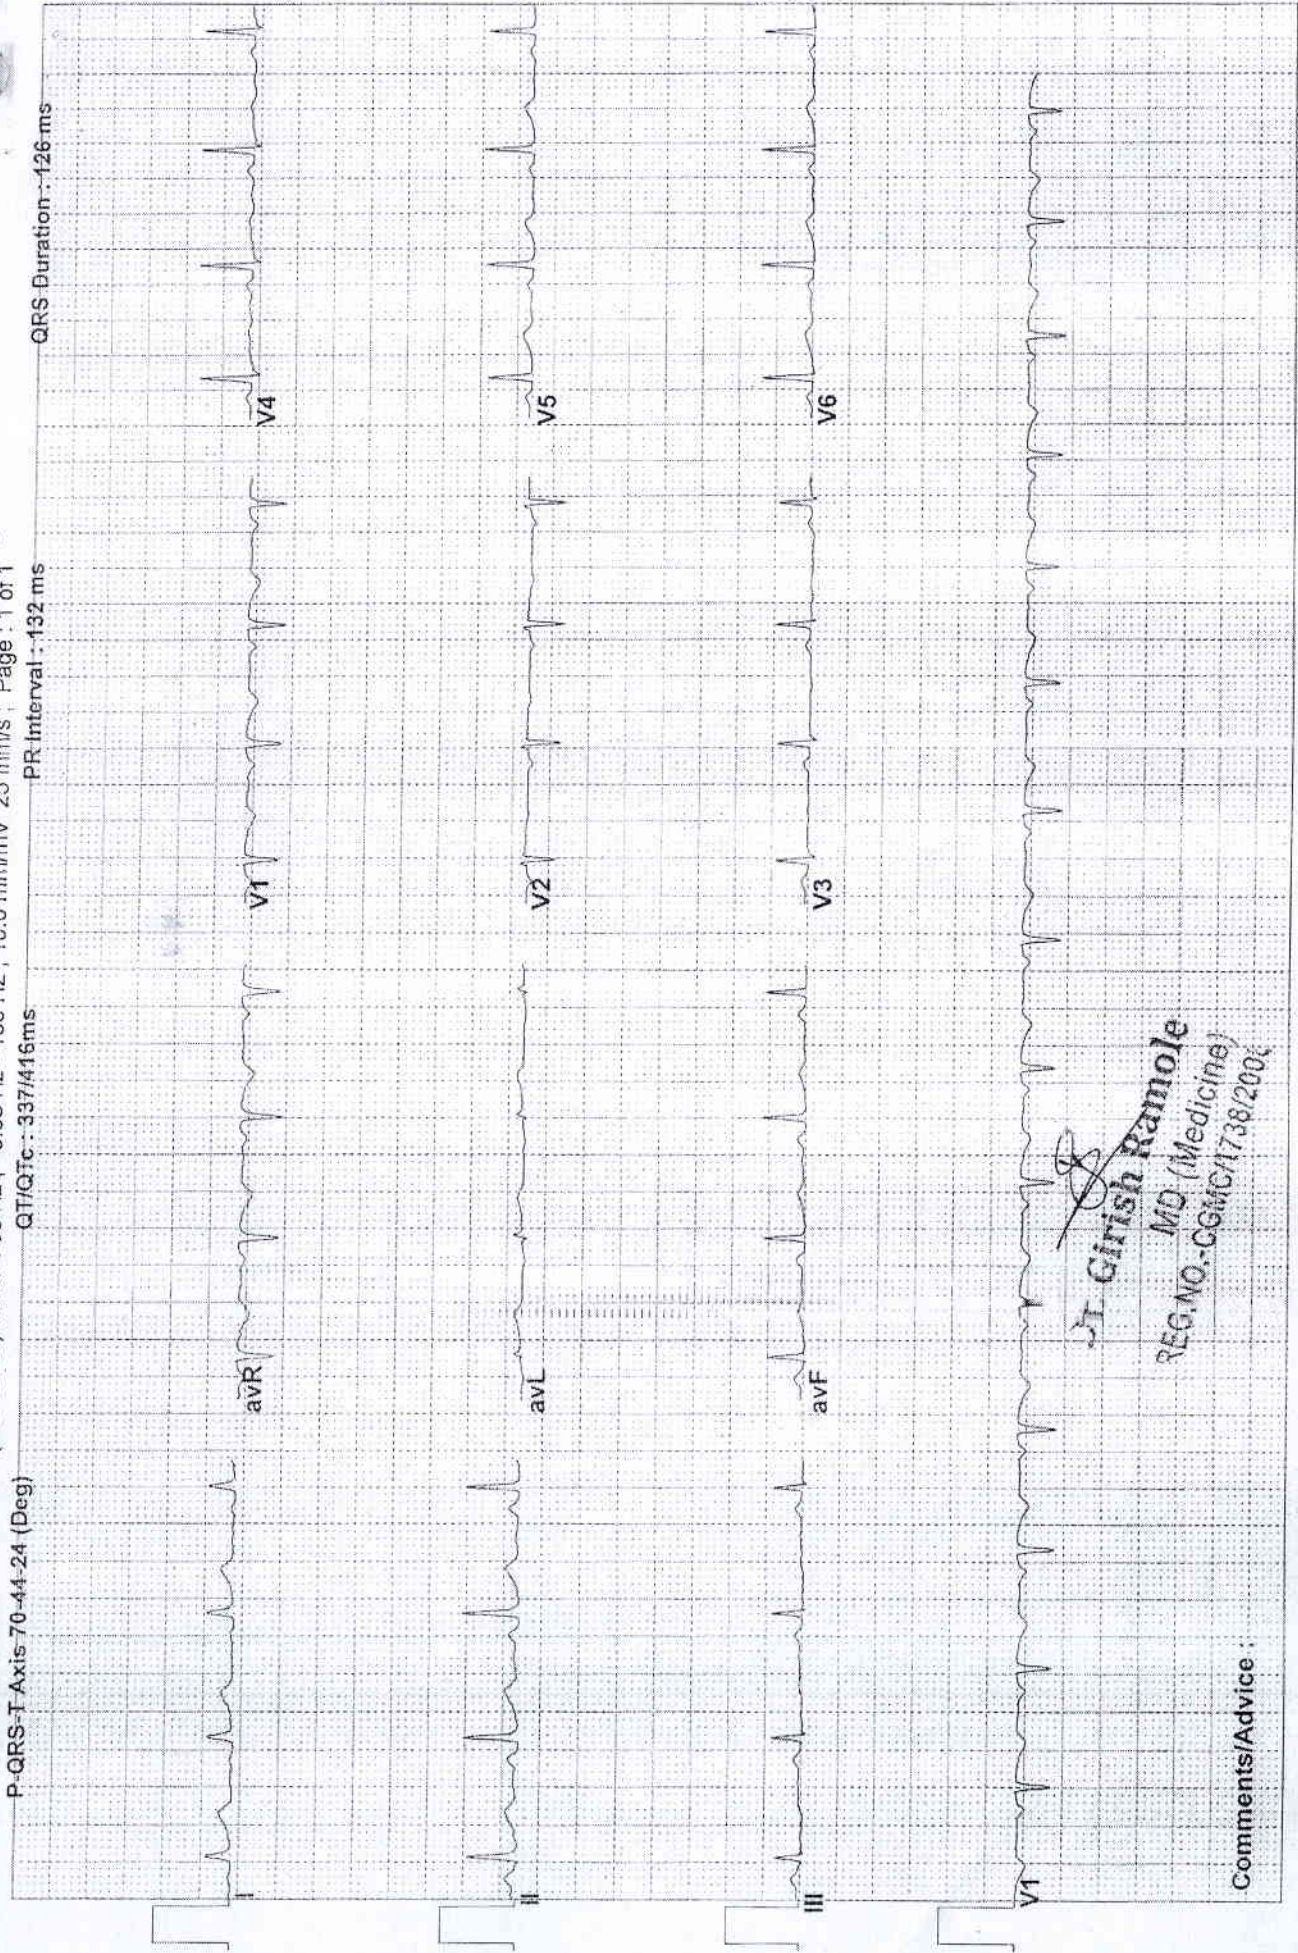

J. Girish Ramole
MD (Medicine)
REG.NO.-CGMCH/738/2006



Comments/Advice :

APOLLO

DIAGNOSTIC CENTRE

DATE 11/1/2025
NAME : MRS KAUSHILYA PRAJAPATI
AGE / SEX 31Y/F
COMPANY : BAJRANG POWER

AUDIOGRAM

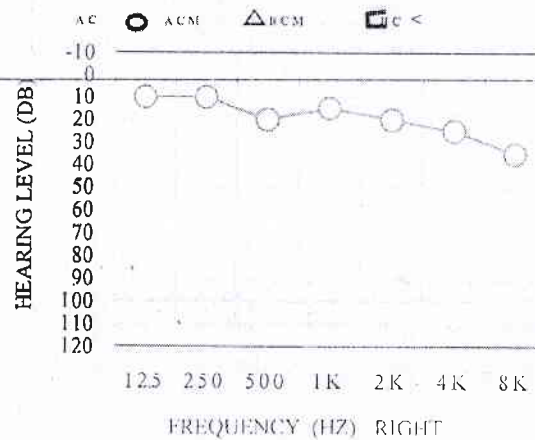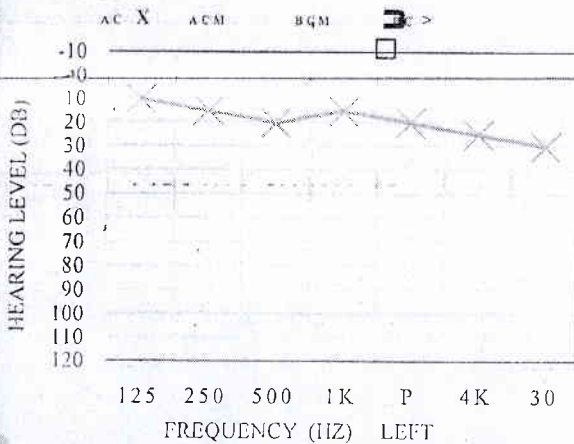

MODE EAR	AIR CONDUCTION		BONE CONDUCTION		COLOUR CODE	THRESHHOLD IN dB		LEFT	RIGHT
	MASKED	UNMASKED	MASKED	UNMASKED		AIR CONDUCTION			
LEFT		x		>	BLUE	BONE CONDUCTION		18.33333333	18.33333
RIGHT				<	RED	SPEECH			
NO RESPONSE : ADD ↓ BELOW THE RESPECTIVE SYMBOLS									

REMARK : B/L NORMAL HEARING SENSITIVITY

Surbhi
DR. SURBHI CHOPRA
(CHATUR MOHTA)
M.S. ENT, HEAD & Neck Surgery
Reg. No.-G-54888

PATIENT NAME : Mrs KAUSHILYA PRAJAPATI

DATE : 11/01/2025

AGE / SEX : 31 Y / Female

UHID NO. : 2025111225345

REF DR. : BAJRANG

पोलो डायग्नोस्टिक सेंटर, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.) 4020988, 4017888

उपलब्ध सुविधाएँ

- 3.0 T एम.आर.आई. (साईलेंट)
- 96 स्लाइस होल बॉडी
स्पाइरल सी.टी.स्कैन
- लिथोट्रिप्सी ESWL
(लेजर द्वारा पथरी का इलाज)
- एर हेरथ चेकअप
- होल बॉडी कलर
सोनोग्राफी (5D)
- लीवर, ब्रेस्ट एवं थायराइड
इलास्टोग्राफी
- वेस्कुलर डापलर
- डिजीटल एक्स-रे
- डिजीटल पोर्टेबल एक्स-रे
- डिजीटल OPG एक्स-रे
- डिजीटल मेमोग्राफी
- कलर डापलर इकोकार्डियोग्राफी
- कम्प्यूटराईज्ड TMT, ई.सी.जी.
- ट्रैंगलॉजी
- FNAC सायटोलॉजी
- कम्प्यूटराईज्ड ई.ई.जी.
- EMG, NCV,
- स्पाइरोमीटर (PFT)
- AMNIOCENTESIS
- C.V.S.
(Chorionic Villus Sampling)

BIO CHEMISTRY

PARAMETERS	RESULT	UNIT	REFERENCE VALUES
Urea	18.0	mg/dl	13 - 45
Creatinine	0.83	mg/dl	0.6 - 1.2
Uric Acid	4.40	mg/dl	2.5-6.8
SGOT (AST)	19.0	U/L	0-45
SGPT (ALT)	21.0	U/L	0-45
Alkaline phosphatase (ALP)	50.0	U/L	39-118
Total Cholesterol	142.0	mg/dl	Desirable <200 Borderline high 200-239 High >240
Triglycerides	123.0	mg/dl	Desirable <150 Borderline high 151-199 High 200-499 Very high >500
HDL Cholesterol	38.0	mg/dl	35-70
VLDL Cholesterol	24.60	mg/dl	7-35
LDL Cholesterol	79.40	mg/dl	Desirable <100 Above desirable 100-129 Borderline high 130-159 High 160-189 Very high >190
GLUCOSE RANDOM	96.0	mg/dl	80-140



For appointment :
91934 89000, 91934 86000

Note - Please Correlate Clinically

Page 1 of 3

- Skin Treatment
- Laser Treatment
- Hair Growth Treatment

3.0T एम.आर.आई. (साईलेंट)

पथरी का इलाज (लिथोट्रिप्सी)

एम्बुलेंस सेवा उपलब्ध

स्किन एंड लेजर ट्रीटमेंट

For-MRI, CT Scan Emergency- 9630898682, 9926892536

For appointment 0771 - 4017888, 4020988



POLLO
STONE
CLINIC

जर्मनी से आयातित अत्याधुनिक सर्वश्रेष्ठ सीमेंस लिथोट्रिप्सी मशीन एवं डार्निंगर लिथोट्रिप्सी मशीन द्वारा किडनी(गुर्दे), यूरैटर(पेशाबनली), पेशाब थैली(ब्लैडर), पित्तनली एवं पैनक्रियाज ग्रंथी में पथरी का उपचार बगैर ऑपरेशन, बिना भर्ती, बेहोशी, चीरफाड़ के उपलब्ध पूरे उपचार का रियायती दरों का पैकेज भी उपलब्ध।

पोलो स्टोन क्लीनिक, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.)
फोन-4020988, 4017888

PATIENT NAME : Mrs KAUSHILYA PRAJAPATI

DATE : 11/01/2025

AGE / SEX : 31 Y / Female

UHID NO. : 2025111225345

REF DR. : BAJRANG

पोलो डायग्नोस्टिक सेंटर, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.) 4020988, 4017888

उपलब्ध सुविधाएँ

- 3.0 T एम.आर.आई (साईलेंट)
- 96 स्लाइस होल बॉडी
स्पाइरल सी.टी.स्कैन
- लिथोट्रिप्सी ESWL
(लेजर द्वारा पथरी का इलाज)
- एर हेल्थ चेकअप
- होल थॉडी कलर
सोनोग्राफी (5D)
- लीवर, ब्रेस्ट एवं थायराइड
इलास्टोग्राफी
- वेस्कुलर डापलर
- डिजीटल एक्स-रे
- डिजीटल पोर्टेबल एक्स-रे
- डिजीटल OPG एक्स-रे
डिजीटल मेमोग्राफी
- कलर डापलर इकोकार्डियोग्राफी
- कम्प्यूटराईज़्ड TMT, ई.सी.जी. CHECKED BY
- एंग्लोजी
- FNAC सायटोलॉजी
- कम्प्यूटराईज़्ड ई.ई.जी.
- EMG, NCV,
- स्पाइरोमीटर (PFT)
- AMNIOCENTESIS
- C.V.S.
(Chorionic Villus Sampling)

HAEMATOLOGY

PARAMETERS	RESULT	UNIT	REFERENCE VALUES
ABO Group	"O"		
Rh Type	POSITIVE		
Total WBC Count	9782	/cumm	4500-11000
Total RBC	5.50	$10^6/\mu l$	3.80-5.50
Haemoglobin	15.3	g/dl	11.5-15.5
Platelet Count	326	$10^3/\mu l$	150-400
Neutrophils	60	%	40 - 75
Lymphocytes	36	%	20 - 40
Eosinophils	01	%	1 - 6
Monocytes	03	%	1 - 10
Basophils	00	%	0 - 1

----- End Of Report -----

DR. S. CHATTERJEE
DCP.DNBE
CON. PATHOLOGIST



For appointment :
91934 89000, 91934 86000

Note - Please Correlate Clinically

Page 3 of 3

- Skin Treatment
- Laser Treatment
- Hair Growth Treatment

3.0T एम.आर.आई (साईलेंट)

पथरी का इलाज (लिथोट्रिप्सी)

एम्बुलेंस सेवा उपलब्ध

स्किन एंड लेज़र ट्रीटमेंट

For-MRI, CT Scan Emergency- 9630898682, 9926892536

For appointment 0771 - 4017888, 4020988



POLLO
STONE
CLINIC

जर्मनी से आयातित अत्याधुनिक सर्वश्रेष्ठ सीमेंस लिथोट्रिप्सी मशीन एवं डार्नियर लिथोट्रिप्सी मशीन द्वारा किडनी(गुर्दे), यूरैटर(पेशाबनली), पेशाब थैली(ब्लैडर), पित्तनली एवं पेनक्रियाज ग्रंथी में पथरी का उपचार बगैर ऑपरेशन, बिना भर्ती, बेहोशी, धीरफाड़ के उपलब्ध पूरे उपचार का रियायती दरों का पैकेज भी उपलब्ध।

पोलो स्टोन क्लीनिक, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.)
फोन-4020988, 4017888

PATIENT NAME : Mrs KAUSHILYA PRAJAPATI

DATE : 11/01/2025

AGE / SEX : 31 Y / Female

UHID NO : 2025111225345

REF DR. : BAJRANG

पोलो डायग्नोस्टिक सेंटर, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.) 4020988, 4017888

उपलब्ध सुविधाएँ

- 3.0 T एम.आर.आई. (साईलेंट)
- 96 स्लाईस होल बॉडी
स्पाइरल सी.टी.स्कैन
- लिथोट्रिप्सी ESWL
(लेजर द्वारा पथरी का इलाज)
- र हेल्थ चेकअप
- होल बॉडी कलर
सोनोग्राफी (5D)
- लीवर, ब्रेस्ट एवं थायराइड
इलास्टोग्राफी
- वेस्कूलर डापलर
- डिजीटल एक्स-रे
- डिजीटल पोर्टेबल एक्स-रे
- डिजीटल OPG एक्स-रे
- डिजीटल मेमोग्राफी
- कलर डापलर इकोकार्डियोग्राफी
- कम्प्यूटाइज्ड TMT, ई.सी.जी.
- एन.एल.जी
- FNAC सायटोलॉजी
- कम्प्यूटाइज्ड ई.ई.जी.
- EMG, NCV,
- स्पाइरोमीटर (PFT)
- AMNIOCENTESIS
- C.V.S.
(Chorionic Villus Sampling)

CLINICAL PATHOLOGY

PARAMETERS RESULT UNIT REFERENCE VALUES

URINE ROUTINE AND MICROSCOPY / URINOGRAM

Physical Examination

COLOUR	Pale yellow		
QUANTITY	20	ml	>30
APPEARANCE	Clear	-	Clear
REACTION	Acidic	-	Acidic

CHEMICAL EXAMINATION

ALBUMIN.	Nil	-	NIL
SUGAR	Nil	%	NIL

MICROSCOPY EXAMINATION

RBC	Nil	/hpf	NIL
PUS CELLS	2-3	/hpf	<5
EPITHELIAL CELLS	1-2	/hpf	<3
CRYSTALS	Absent	-	Absent
CASTS	Absent	-	Absent
BACTERIA	Absent	-	Absent

Others(Urine)



For appointment :
91934 89000, 91934 86000

Note - Please Correlate Clinically

Page 2 of 3

- Skin Treatment
- Laser Treatment
- Hair Growth Treatment

3.0T एम.आर.आई. (साईलेंट)

पथरी का इलाज (लिथोट्रिप्सी)

एम्बुलेंस सेवा उपलब्ध

स्किन एंड लेजर ट्रीटमेंट

For-MRI, CT Scan Emergency- 9630898682, 9926892536

For appointment: 0771 - 4017888, 4020988



जर्मनी से आयातित अत्याधुनिक सर्वश्रेष्ठ सीमेंस लिथोट्रिप्सी मशीन एवं जार्नियर लिथोट्रिप्सी मशीन द्वारा किडनी(पुर्दे), यूरेटर(पेशाबनली), पेशाब थैली(ब्लैडर), पित्तनली एवं पैनक्रियाज ग्रंथी में पथरी का उपचार बगैर ऑपरेशन, बिना भर्ती, बेहोशी, चीरफाड़ के उपलब्ध पूरे उपचार का रियायती दरों का पैकेज भी उपलब्ध।

पोलो स्टोन क्लीनिक, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.)
फोन-4020988, 4017888

Pt. Name :- MRS.KAUSHILYA PRAJAPATI

Sex - F

Ref by Dr. :- BAJRANG ALLIANCE

Date - 11.01.2025

पोलो डायग्नोस्टिक सेंटर, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.) 4020988, 4017888

उपलब्ध सुविधाएँ

- 3.0 T एम.आर.आई (साईलेंट)
- 96 स्लाईस होल बॉडी
स्पाइरल सी.टी.स्कैन
- लिथोट्रिप्सी ESWL
(लेजर द्वारा पथरी का इलाज)
- ...टर हेल्थ चेकअप
- होल बॉडी कलर
सोनोग्राफी (5D)
- लीवर, ब्रेस्ट एवं थायराईड
इलास्टोग्राफी
- वेस्कुलर डापलर
- डिजीटल एक्स-रे
- डिजीटल पोर्टेबल एक्स-रे
- डिजीटल OPG एक्स-रे
- डिजीटल मेमोग्राफी
- कलर डापलर इकोकार्डियोग्राफी
- कम्प्यूटराइज़्ड TMT, ई सी जी
- हैर ग्लोबी
- FNAC सायटोलॉजी
- कम्प्यूटराइज़्ड ई.ई.जी.
- EMG, NCV,
- स्पाइरोमीटर (PFT)
- AMNIOCENTESIS
- C.V.S.
(Chorionic Villus Sampling)

ULTRASONOGRAPHY OF WHOLE ABDOMEN

**DONE BY MOST ADVANCED LIVE 4 – D – RS-80A (SAMSUNG)
WHOLE BODY COLOUR DOPPLER MACHINE**

LIVER :- Appears normal in size and outline with normal homogenous echotexture. No focal parenchymal lesion seen. Intrahepatic biliary radicles are not dilated, no calculi seen.

GALL BLADDER:- Appears normal in size, shape and wall thickness without any evidence of stone or any mass lesion in it.

PV AND CBD:-Measurements are within normal limits. No calculi shadow seen in CBD.

PANCREAS :-Shows normal homogenous echotexture. No focal parenchymal Lesion seen.

BOTH KIDNEY:-Both kidneys appears normal in size, shape & echotexture, No focal parenchymal lesion seen. No evidence of stone, hydronephrosis or any mass lesion seen.

SPLEEN :- Appears normal in size, shape & echotexture.

URINARY BLADDER :-Appears normal in size, shape and wall thickness, No intraluminal pathology seen.

UTERUS :-Is anteverted normal in size with smooth outline. The myometrium shows homogenous echotexture. The endometrium is in midline & shows no significant abnormality.

OVARIES : Both ovaries are visualised and appears normal in size, shape and echotexture.

* No evidence of lymphadenopathies or ascites seen.

IMPRESSION:- Normal U. S. study.

Dr. Paras Jain
MBBS. DMR
(Consultant Radiologist &
Ultrasonologist)



For appointment :
91934 89000, 91934 86000

- Skin Treatment
- Laser Treatment
- Hair Growth Treatment

3.0T एम.आर.आई (साईलेंट)

पथरी का इलाज (लिथोट्रिप्सी)

एम्बुलेंस सेवा उपलब्ध

स्किन एंड लेजर ट्रीटमेंट

For-MRI, CT Scan Emergency- 9630898682, 9926892536

For appointment 0771 - 4017888, 4020988



**POLLO
STONE
CLINIC**

जर्मनी से आयातित अत्याधुनिक सर्वश्रेष्ठ सीमेंस लिथोट्रिप्सी मशीन एवं डार्मियर लिथोट्रिप्सी मशीन द्वारा किडनी (गुर्दे), यूरेटर (पेशाबनली), पेशाब थैली (ब्लैडर), पित्तनली एवं पैनक्रियाज ग्रंथी में पथरी का उपचार बगैर ऑपरेशन, बिना भत्ती, बेहोशी, चीरफाड़ के उपलब्ध पूरे उपचार का रियायती दरों का पैकेज भी उपलब्ध।

पोलो स्टोन क्लीनिक, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.)
फोन-4020988, 4017888

APOLLO DIAGNOSTIC CENTRE RAIPUR

181/5, Phase-I, Industrial Area, Chandigarh-160002

Patient: MRS KAUSHILYA PRAJAPATI

Age : 31 Years

Gender : Female

Refd. By: BAJRANG POWER

Height : 150 Cms

Smoker : No

Pred. Eqns: RECORDERS

Weight : 35 Kgs

Eth. Corr: 70

Date : 11-Jan-2025 04:33 PM

ID: 308973



Temp :



F(Litres/Sec)

FEV1 %Pred COPD SEVERITY

FVC%Pred Interpretation

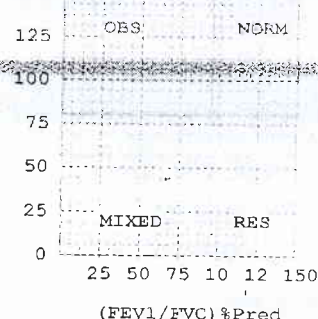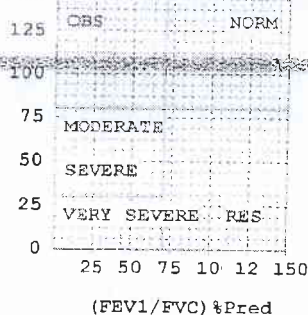

Spirometry (FVC Results)

Parameter	Pred	M. Pre	%Pred	M. Post	%Pred	%Imp
FVC (L)	01.51	01.96	130			
FEV1 (L)	01.22	01.93	158			
FEV1/FVC (%)	80.79	98.47	122			
FEF25-75 (L/s)	01.86	02.59	139			
PEFR (L/s)	04.16	05.47	131			
FIVC (L)	01.46	01.52	105			
FEV.5 (L)	01.46	01.96	134			
PIFR (L/s)	02.76	01.11	40			
FEF75-85 (L/s)	03.44	03.50	102			
FEF.2-1.2 (L/s)	03.93	04.90	125			
FEF 25% (L/s)	03.04	02.78	091			
FEF 75% (L/s)	01.74	01.51	087			
FEV.5/FVC (%)	77.55					
FEV3/FVC (%)	96.69	100.00	103			
FET (Sec)	01.25					
ExptTime (Sec)	00.06					
Lung Age (Yrs)	031	010	042			
FEV6 (L)	01.51					
FIF25% (L/s)	00.82					
FIF50% (L/s)	02.76					
FIF75% (L/s)	02.23					

Pre Test COPD Severity

Test within normal limits

Dr. Paras Jain
MBBS, DMR
Regd. No.-3850
Apollo Diagnostic Centre
RAIPUR (C.G.)

Pre Medication Report Indicates

Spirometry within normal limits as (FEV1/FVC)%Pred >95 and FVC%Pred >80.

Pt. Name :- MRS.KAUSHILYA PRAJAPATI

Sex - F

Ref by Dr. :- BAJRANG ALLIANCE

Date - 11.01.2025

पोलो डायग्नोस्टिक सेंटर, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.) 4020988, 4017888

उपलब्ध सुविधाएँ

- 3.0 T एम.आर.आई (साईलेंट)
- 96 स्लाईस होल बॉडी
स्पाइरल सी.टी.स्कैन
- लिथोट्रिप्सी ESWL
(लेजर द्वारा पथरी का इलाज)
- एंटर हेल्थ चेकअप
- होल बॉडी कलर
सोनोग्राफी (5D)
- लीवर, ब्रेस्ट एवं थायराईड
इलास्टोग्राफी
- वेस्कूलर डापलर
- डिजीटल एक्स-रे
- डिजीटल पोर्टेबल एक्स-रे
- डिजीटल OPG एक्स-रे
- डिजीटल मेमोग्राफी
- कलर डापलर इकोकार्डियोग्राफी
- कम्प्यूटराईज़्ड TMT, ई.सी.जी.
- एंजेलोजी
- FNAC सायटोलॉजी
- कम्प्यूटराईज़्ड ई.ई.जी.
- EMG, NCV,
- स्पाइरोमीटर (PFT)
- AMNIOCENTESIS
- C.V.S.
(Chorionic Villus Sampling)

X-RAY CHEST PA VIEW

Both lung fields are clear no active parenchymal lesion seen.

Both costophrenic angles are clear.

Cardiothoracic ratio is within normal limits, Cardiac shadow shows no significant abnormality.

Thoracic bone cage appears normal.

Diaphragmatic outline are clearly delineated.

IMPRESSION:- Normal Findings.


DR. PARAS JAIN
MBBS, DMR
Consultant Radiologist &
Ultrasonologist



For appointment :
91934 89000, 91934 86000

- Skin Treatment
- Laser Treatment
- Hair Growth Treatment

3.0T एम.आर.आई (साईलेंट)

पथरी का इलाज (लिथोट्रिप्सी)

एम्बुलेंस सेवा उपलब्ध

स्किन एंड लेजर ट्रीटमेंट

For-MRI, CT Scan Emergency- 9630898682, 9926892536

For appointment 0771 - 4017888, 4020988



POLLO
STONE
CLINIC

जर्मनी से आयातित अत्याधुनिक सर्वश्रेष्ठ सीमेंस लिथोट्रिप्सी मशीन एवं डार्नियर लिथोट्रिप्सी मशीन द्वारा किडनी (गुर्दे), यूरेटर (पेशाबनली), पेशाब थैली (ब्लैडर), पित्तनली एवं पैनक्रियाज ग्रंथी में पथरी का उपचार बगैर ऑपरेशन, बिना भर्ती, बेहोशी, चीरफाड़ के उपलब्ध पूरे उपचार का रियायती दरों का पैकेज भी उपलब्ध।

पोलो स्टोन क्लीनिक, अपोलो टॉवर, एक्सप्रेस हाईवे फ्लाई ओवर के पास देवेन्द्र नगर, रायपुर (छ.ग.)
फोन-4020988, 4017888


**SHRI BAJARNG POWER & ISPAT LIMITED
(BORJHARA DIVISION)**

RAIN WATER HARVESTING SYSTEM

Pit No. 1 (Near Solar PP)



Pit No. 2 (Near Steel Melting Shop)

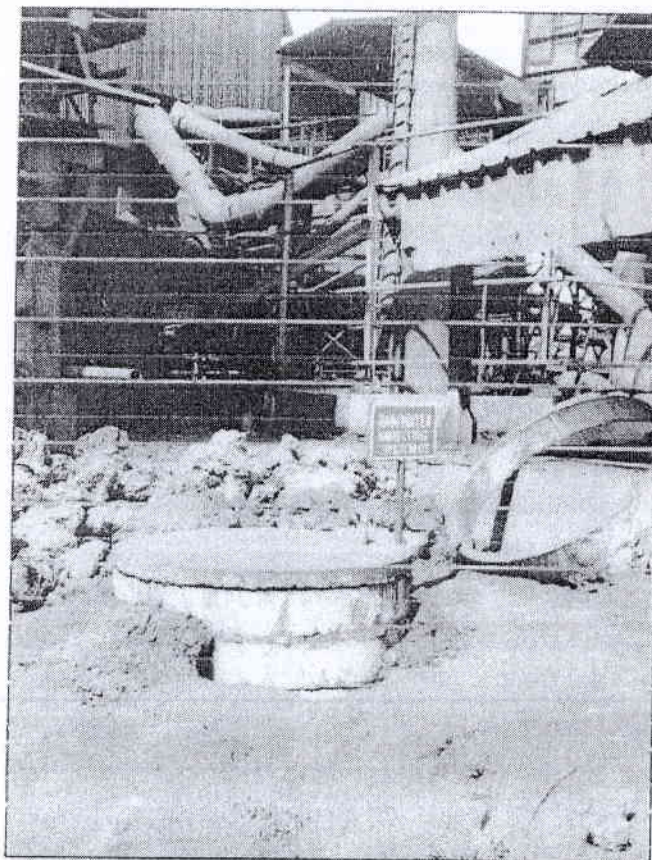

Handwritten signature

Pit No. 3 (Near Ferro Alloys Unit)



Pit No. 4 (Near Rolling Mill)



W. J.

Pit No. 5 (Near Power Plant)



Vol